


Fairfax County Park Authority
Volunteer Training
Electrical Safety

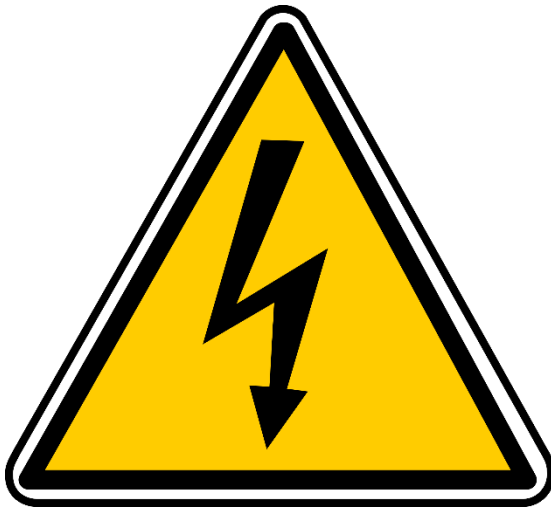

Electrical Safety

- Trained staff
- Lock out-tag out
- Extension cords
- Multi plug adaptors

Electrical Safety

Trained staff: Only designated trained staff are authorized to work on electrical components. Please do not flip breakers, open electrical panels, etc.


Lock out tag out: When trained staff are working on electrical components, a “lock out” tag is installed at the panel to notify others the power has been disconnected. Please do not make any changes (i.e., turn breakers on).



Electrical Safety

Extension cords: Extension cords are permitted for short-term or temporary use only. They are not approved for permanent use. Please inspect all cords prior to use for any damages, exposed wires, etc.

Multi plug adaptors: Please do not overload multi plug adaptors. Speak with supervisor if additional electrical outlets are necessary.

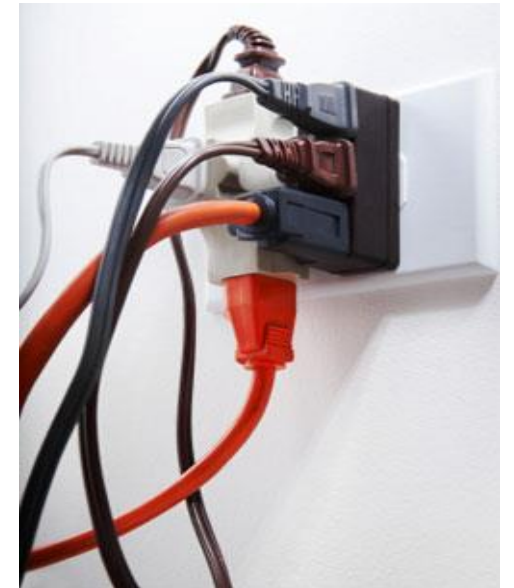

<https://www.flickr.com/photos/statefarm/8203770880>