
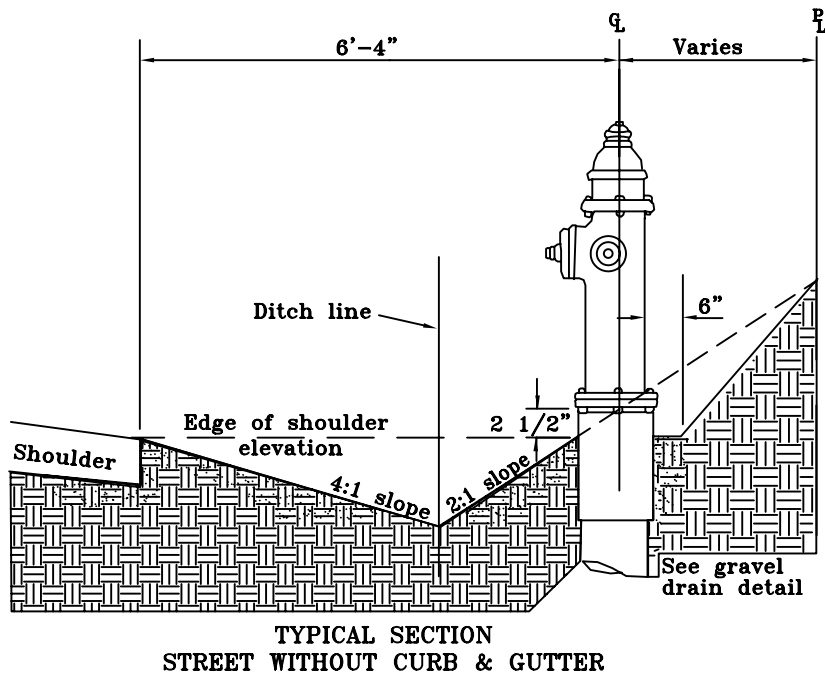


FAIRFAX COUNTY PUBLIC FACILITIES MANUAL

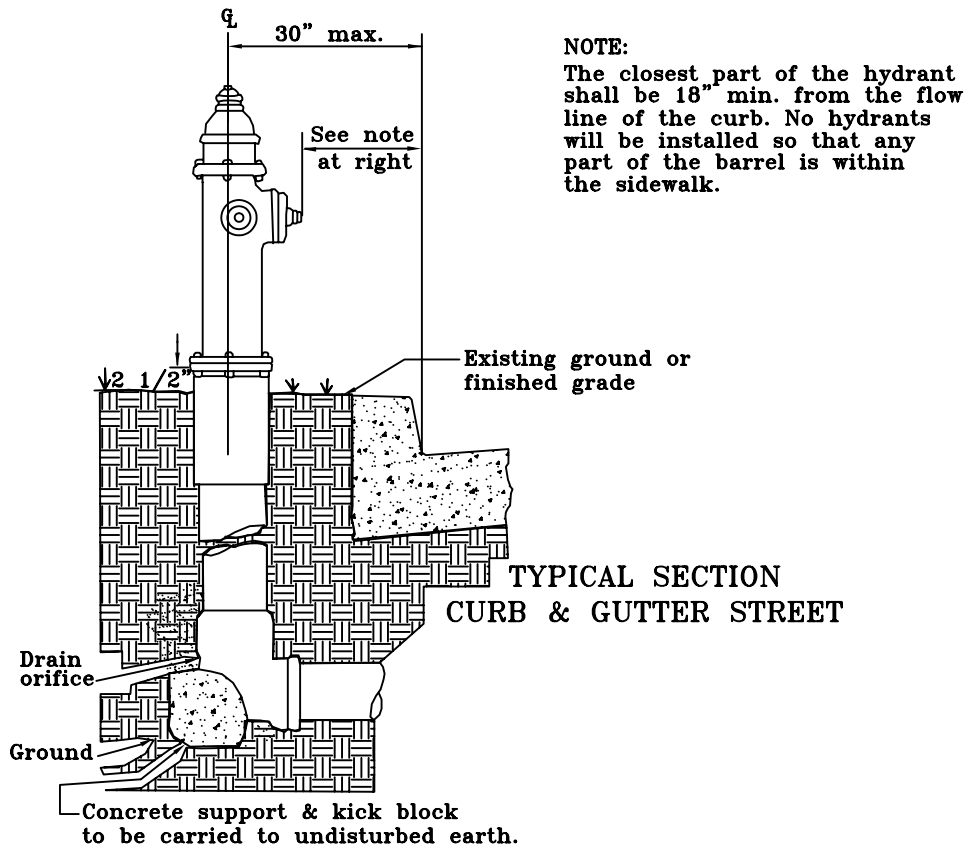

Ref. Sec. 9-0202.2B

Rev. 1-00, 5-07, 2011
Reprint

LOCATION OF FIRE HYDRANTS


PLATE NO.

1-9

STD. NO.

FH-1

FAIRFAX COUNTY PUBLIC FACILITIES MANUAL

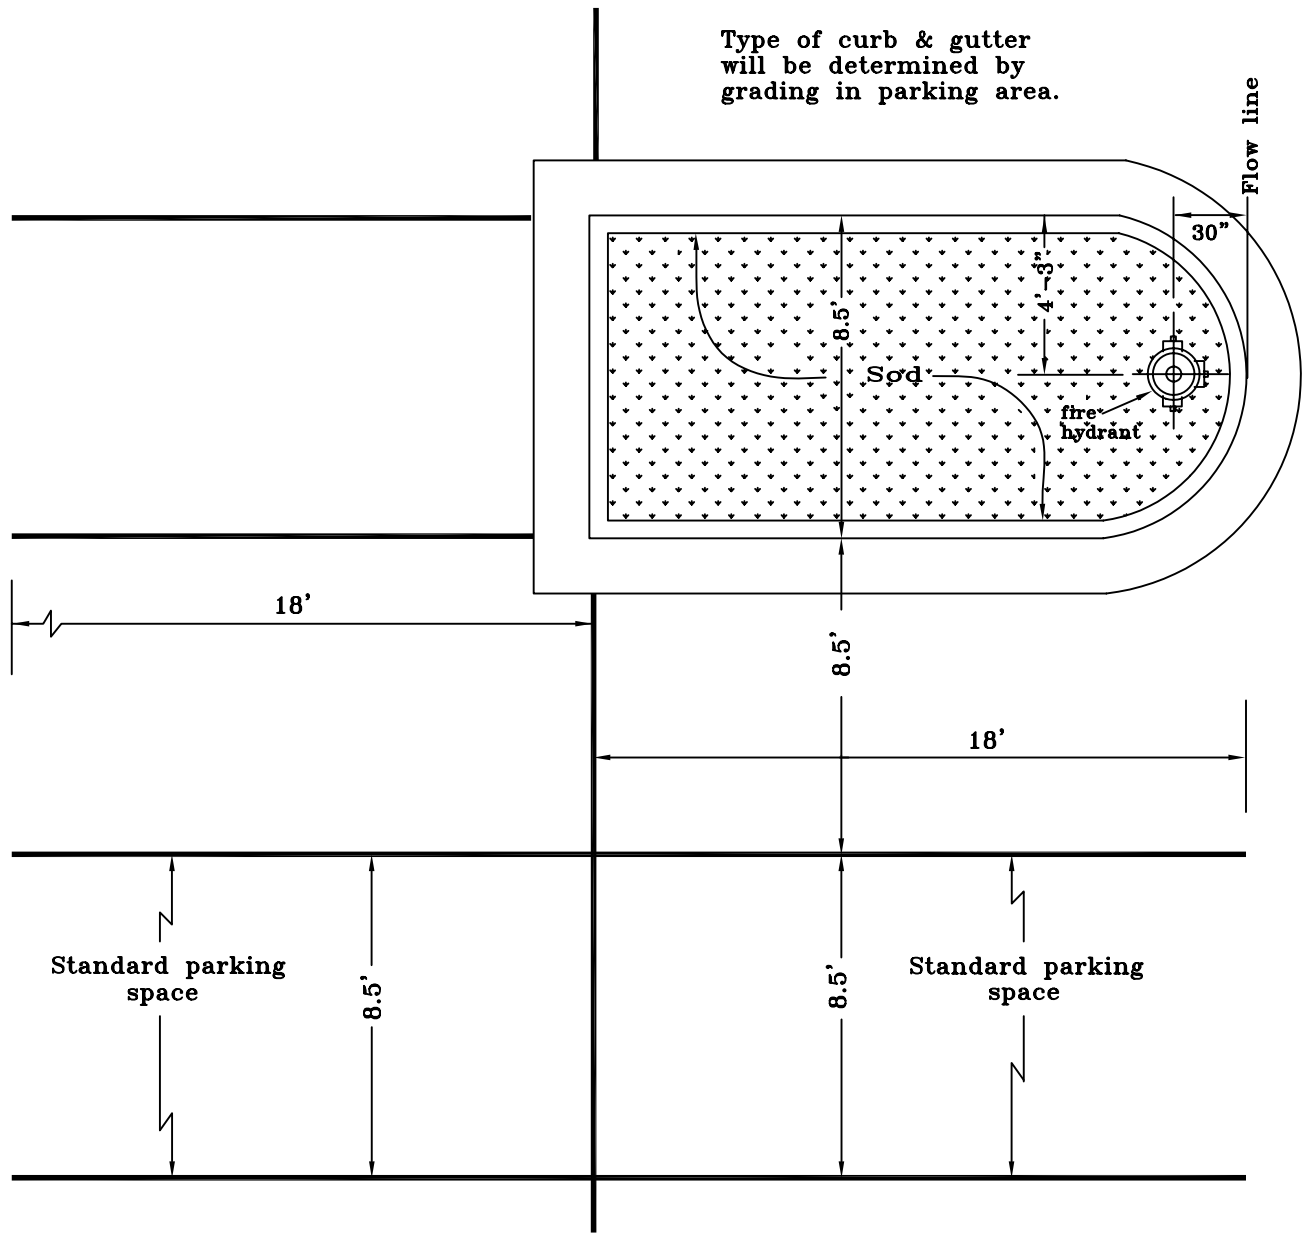

Ref. Sec. 9-0202.2B

Rev. 1-00, 5-07, 2011
Reprint

STANDARD FIRE HYDRANT ISLAND-PARKING AREA


PLATE NO.

2-9

STD. NO.

FH-2

FAIRFAX COUNTY PUBLIC FACILITIES MANUAL

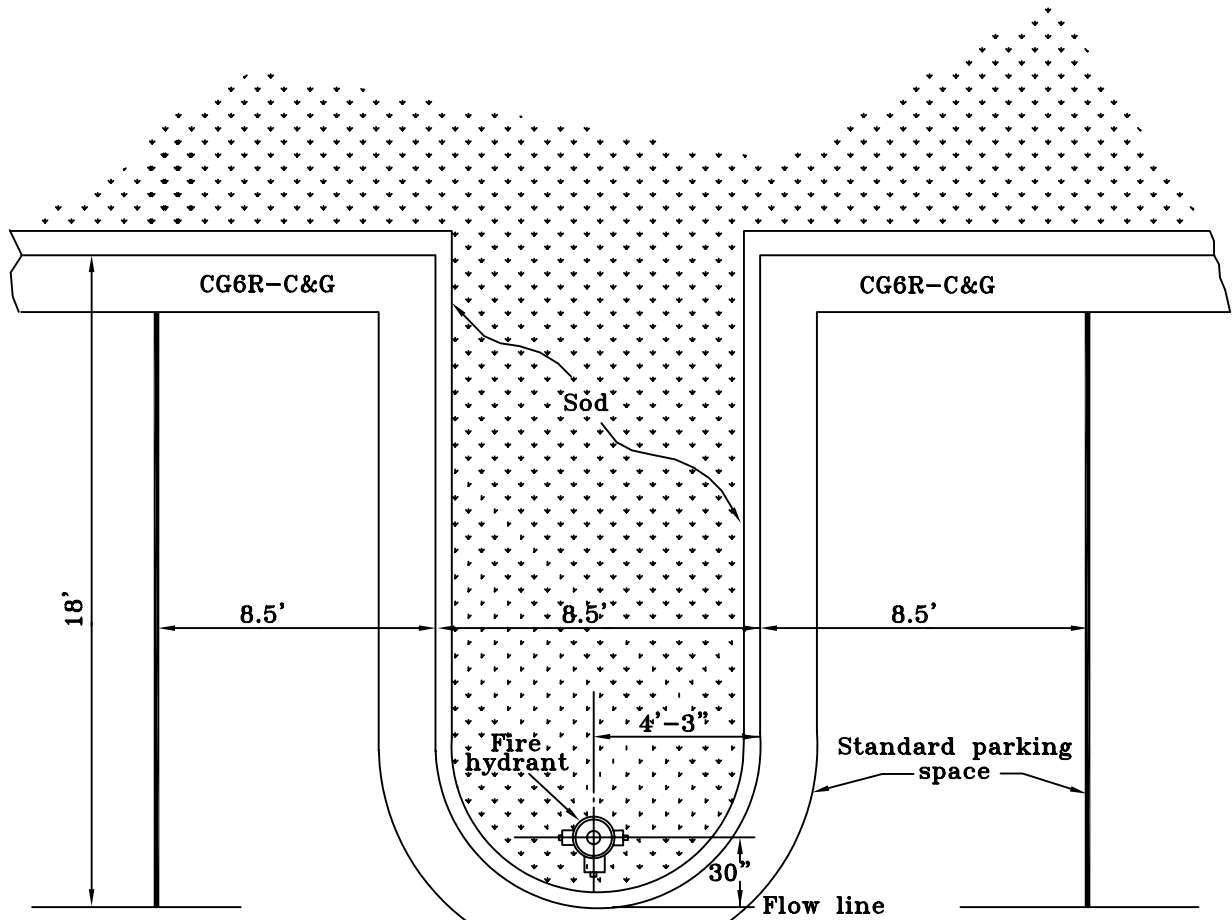

Ref. Sec. 9-0202.2B

STANDARD FIRE HYDRANT ISLAND PARKING AREAS

PLATE NO.


STD. NO.

3-9

FH-3

Rev. 1-00, 5-07, 2011
Reprint

FAIRFAX COUNTY PUBLIC FACILITIES MANUAL

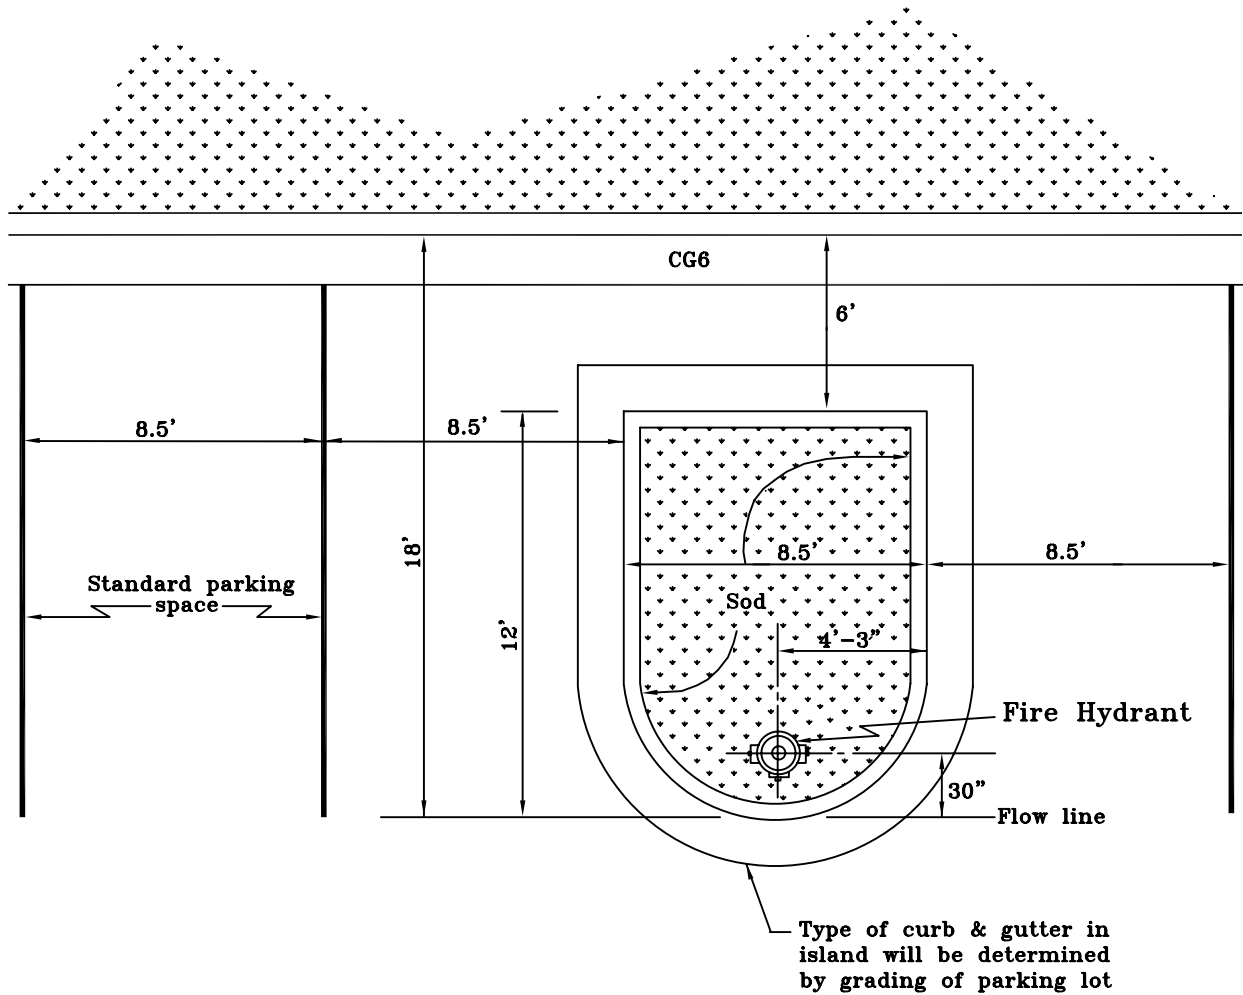

Ref. Sec. 9-0202.2B

STANDARD FIRE HYDRANT ISLAND - PARKING

PLATE NO.


STD. NO.

4-9

FH-4

Rev. 1-00, 5-07, 2011
Reprint

FAIRFAX COUNTY PUBLIC FACILITIES MANUAL

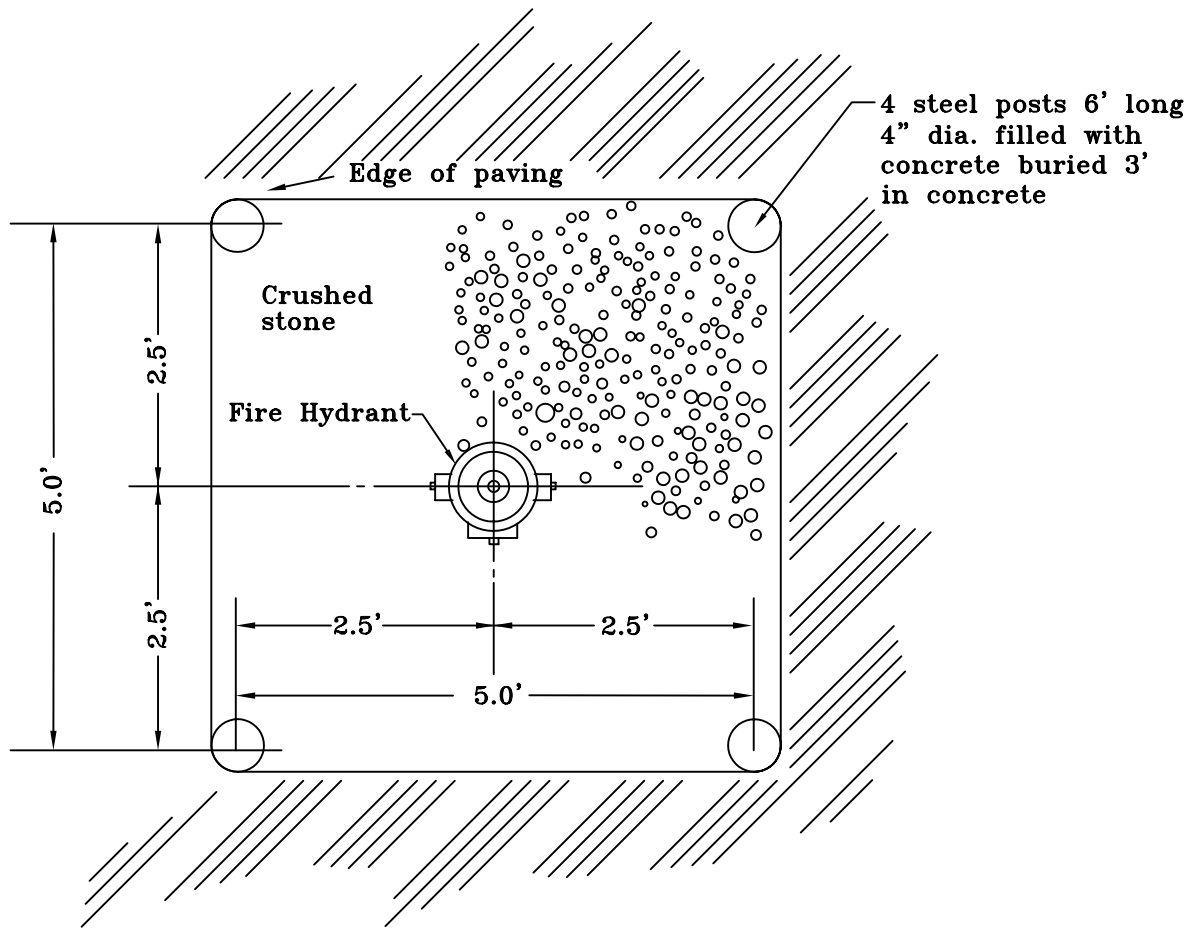

Ref. Sec. 9-0202.2B

Ref. 1-00, 2011 Reprint

**FIRE HYDRANT PROTECTION
IN AREA WHERE ISLAND
CANNOT BE CONSTRUCTED**

PLATE NO.

STD. NO.

5-9

FH-5

FAIRFAX COUNTY PUBLIC FACILITIES MANUAL

FIRE LANE DESIGNATIONS

Under Section 503.1.1 of the Fairfax County Fire Prevention Code, the Office of the Fire Marshal is authorized to designate fire lanes on public streets and on private property where necessary. This is to prevent parking in front of, or adjacent to, fire hydrants and to provide access for fire fighting equipment. Markings and signs are to be provided by the owner or agent of the property involved. Parking or otherwise obstructing such areas is prohibited.

I. HYDRANTS

- A. Parking is prohibited within 15' of a fire hydrant located along the curb line or edge of any public or private roadway. No special curb marking is required for enforcement.
- B. Fire hydrants installed in parking lots are to be located within a fire lane. Curb and/or roadway marking is required in accordance with Sections III and IV below.

II. FIRE LANES

- A. Fire lanes shall be installed where required by the Office of the Fire Marshal. Fire lanes shall be marked with both sign and curb delineation per Section III and IV below. Parking and traffic flow patterns shall be required as follows:

STANDARD REQUIREMENTS

Street Width Curb to Curb	One-Way Traffic	Two-Way Traffic
Less than 24'	No parking on either side of street	No parking on either side of street
24' to 29'	Parallel parking on one side as decided by Fairfax County Office of the Fire Marshal	No parallel parking on either side of street
30' to 35'	Parallel parking allowed on both sides of street	Parallel parking on one side as decided by Fairfax County Office of the Fire Marshal
36' or greater	Parallel parking allowed on both sides of street	Parallel parking allowed on both sides of street

SIGN TYPE "A"



Standard wording with an arrow at bottom pointing to the right. One sign mounted parallel to the line of curbing or pavement edge at end of painted area.

SIGN TYPE "C"



Standard wording with an arrow at bottom pointing to the left. One sign mounted parallel to the line of curbing or pavement edge at end of painted area.

SIGN TYPE "D"



Standard wording with no arrow. Two signs, back to back, mounted perpendicular to line of curbing or pavement edge.

III. SIGN SPECIFICATIONS

- A. Metal construction, 12" X 18"
- B. Red letters on reflective white background with 3/8" red trim strip around entire outer edge of sign.
- C. Lettering on sign to be: "NO PARKING OR STANDING FIRE LANE".
- D. Lettering size to be as follows: "NO PARKING" and "STANDING" is 2", "OR" is 1" "FIRE LANE" is 2 1/2" and the arrow with the solid shaft is 1" x 6" with the solid head 1 1/2" wide and 2" deep.
- E. Signs are to be mounted 7' from the ground to the bottom of the sign unless otherwise directed by the Office of the Fire Marshal.
- F. Post for signs, when required, shall be metal and securely mounted, unless written permission for alternatives is obtained prior to installation from the Office of the Fire Marshal. Signs should be spaced as shown on approved plans. In long stretches, the maximum distance between signs is 70'.
- G. Other special signs may be approved by the Office of the Fire Marshal.

IV. CURB DESIGNATION

- A. All curbs or paved spaces designated as fire lanes shall be indicated by yellow paint as approved by the Office of the Fire Marshal. In areas without curbing, a 6" wide yellow stripe shall be applied to the edge of the pavement. Paint shall be highway traffic grade.

NOTE: Fire lane markings, types of signs, locations, etc. shall be subject to the approval by Office of the Fire Marshal.

Ref. Sec. 9-0202.2J(5)

Rev. 1-00, 2-07, 2011
Reprint

FIRE LANES

PLATE NO.

STD. NO.

6-9

FH-7