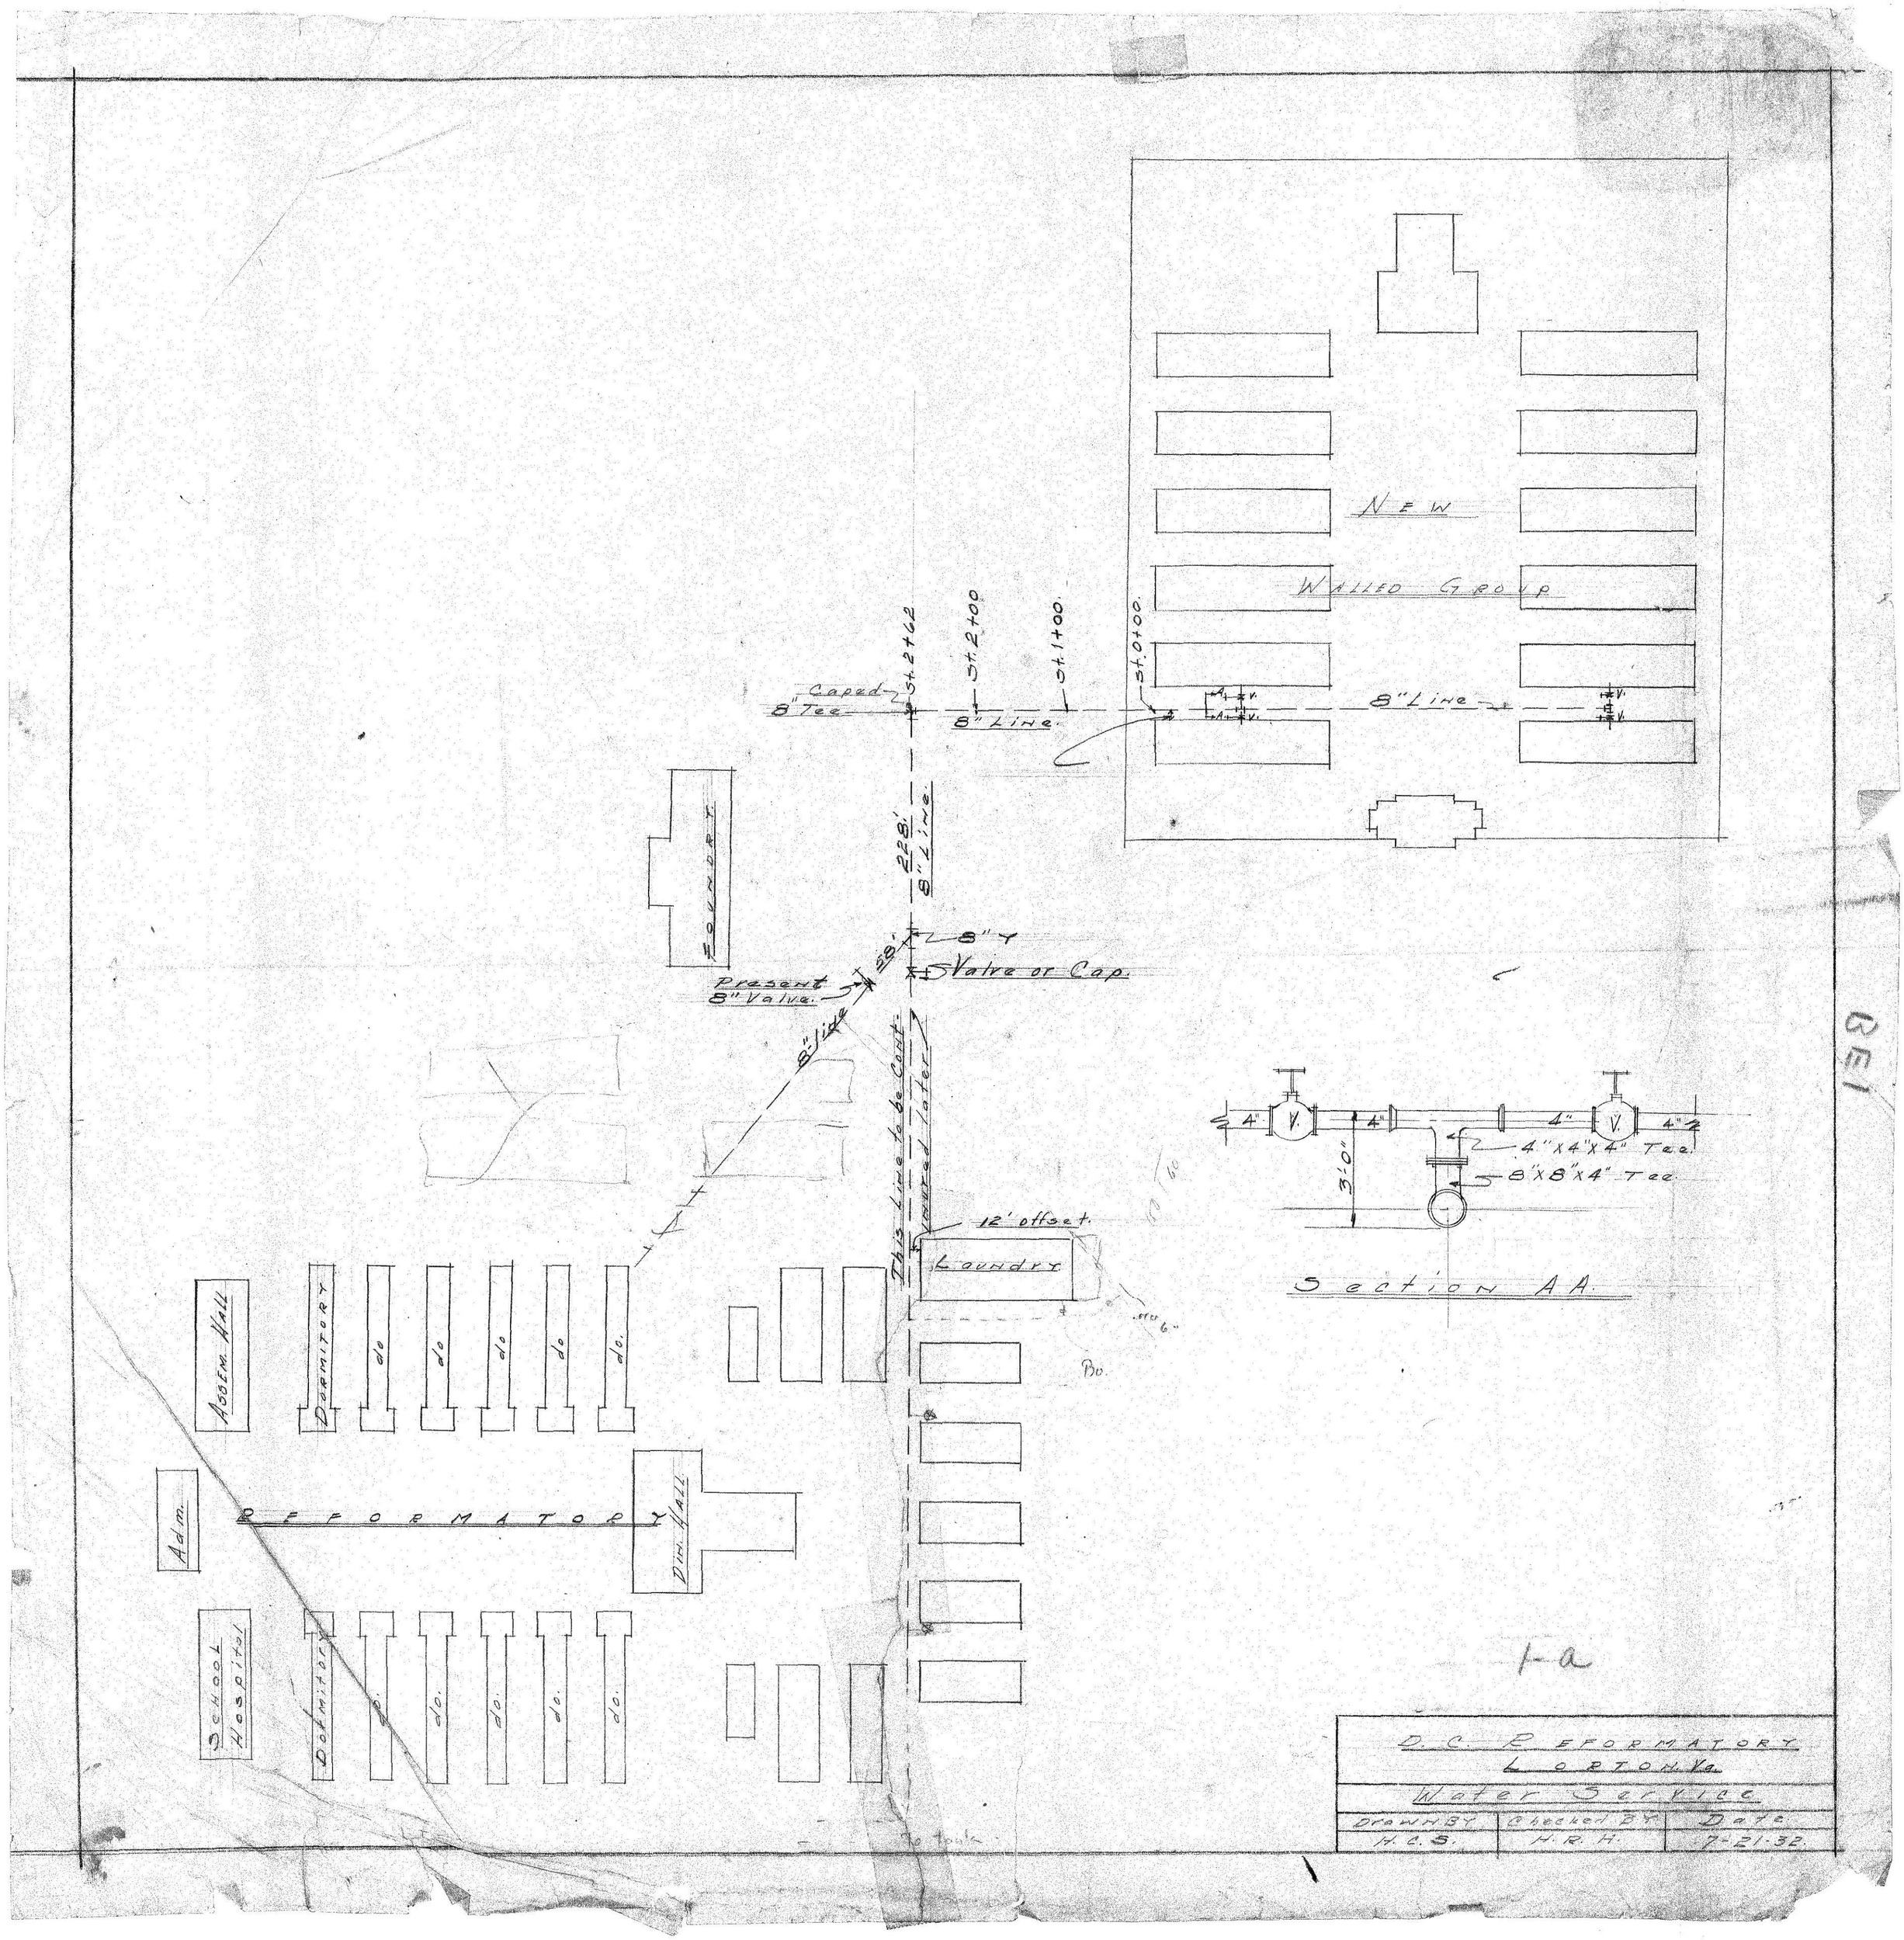

New
Walled Group
St. 2+62
St. 2+00
St. 1+00
St. 0+00
Capped
8" Tee
8" Line
8" Line
228'
8" Line
Foundry
8" Y
Valve or Cap.
Present
8" Valve
8" line
This Line to be Cont.
Laundry
12' offset
Bo.
4"
V.
4"
4"
V.
4"
4"x4"x4" Tee
8"x8"x4" Tee
3'-0"
Section AA
Assem. Hall
Dormitory
do
do
do
do
do
Adm.
Reformatory
Din. Hall
School Hospital
Dormitory
do
do
do
do
do
1-a
D. C. Reformatory
Lorton, Va.
Water Service
Drawn By
H. C. S.
Checked By
H. R. H.
Date
7-21-32