PANELBOARD SCHEDULE

PANEL	LOCATION	MTG.	BUS CAP.	FEEDER	CONG.	ACTIVE BRANCH CIRCUITS NO.	FUSE	POLE	TO FEED	SPARE CIRS. NO.	POLE	REMARKS
MDP	CONV. ROOM	SURFACE	400	4-4/0	U.G. DUCT	1	200	3	PANEL "A"	-	-	
						1	70	3	PANEL "D"	1	3	
						1	70	3	PANEL "G"	-	-	
						1	100	3	-	-	-	SUB-MAIN
						1	15	3	SUMP PUMP	1	3	
						2	15	1	LIGHTS	2	1	
"A"	CONV. ROOM	SURFACE	200	4-4/0	U.G. DUCT	1	70	3	PANEL "B"	1	3	
						1	70	3	PANEL "C"	-	-	
						1	100	3	-	-	-	SUB-MAIN
						1	60	3	PANEL "E"	-	-	
						1	60	3	PANEL "F"	-	-	
						1	15	3	SUMP PUMP	1	3	
						2	15	1	LIGHTS	2	1	
"B"	1st FLOOR	FLUSH	100	4-#6	1 1/4	25	15	1	LIGHTS	3	1	
"C"	1st FLOOR	FLUSH	100	4-#6	1 1/4	28	15	1	LIGHTS	4	1	
"D"	1st FLOOR	FLUSH	100	4-#6	1 1/4	19	15	1	LIGHTS	5	1	
"E"	2nd FLOOR	FLUSH	100	4-#6	1 1/4	13	15	1	LIGHTS	3	1	
"F"	2nd FLOOR	FLUSH	100	4-#6	1 1/4	27	15	1	LIGHTS	4	1	
						1	20	1	MOTORS	-	-	
"G"	2nd FLOOR	FLUSH	100	4-#6	1 1/4	24	15	1	LIGHTS	4	1	

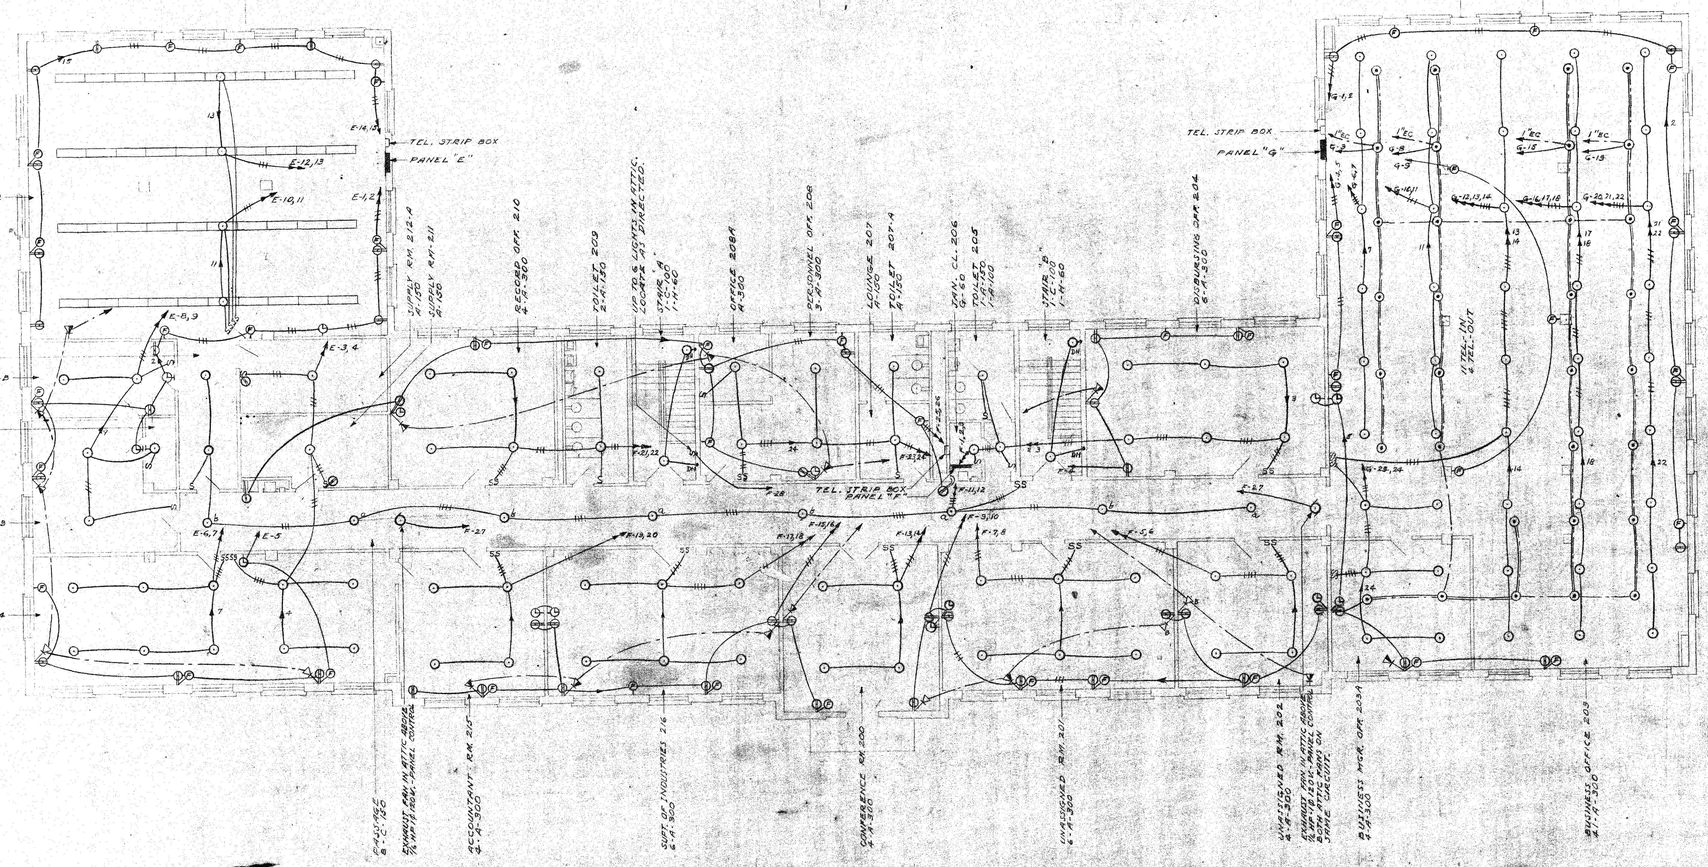

SCALE 1/8 IN. = 1'-0"

FIXTURE NOMENCLATURE

B-300 INDICATES TYPE "B" FIXTURE WITH 300W LAMP.
6-B-300 INDICATES 6 SUCH FIXTURES IN ONE ROOM.

TYPE	DESCRIPTION
A	GLASS ENCLOSED - CEILING MTD.
B	SEMI-INDIRECT - PENDANT
C	ROUND GLASS BOX - 2 LAMP
D	EXTERIOR BRACKET
E	ALM FIXTURE - CEILING MTD.
F	FLUORESCENT 2/40 WATT
G	BOX COVER RECEPTACLE
H	V. P. BRACKET

SECOND FLOOR PLAN

WORK RECORD
DRAWN BY DSK
TRACED BY DSK
CHECKED BY DSK
DATE [illegible]
SHEET 24 OF 24

NEW CONTROL CENTER

D. C. REFORMATORY
LORTON, VIRGINIA

OFFICE OF THE MUNICIPAL ARCHITECT

FILE NO.

SHEET NO. E/2

RETURN TRACINGS TO PLAN FILES