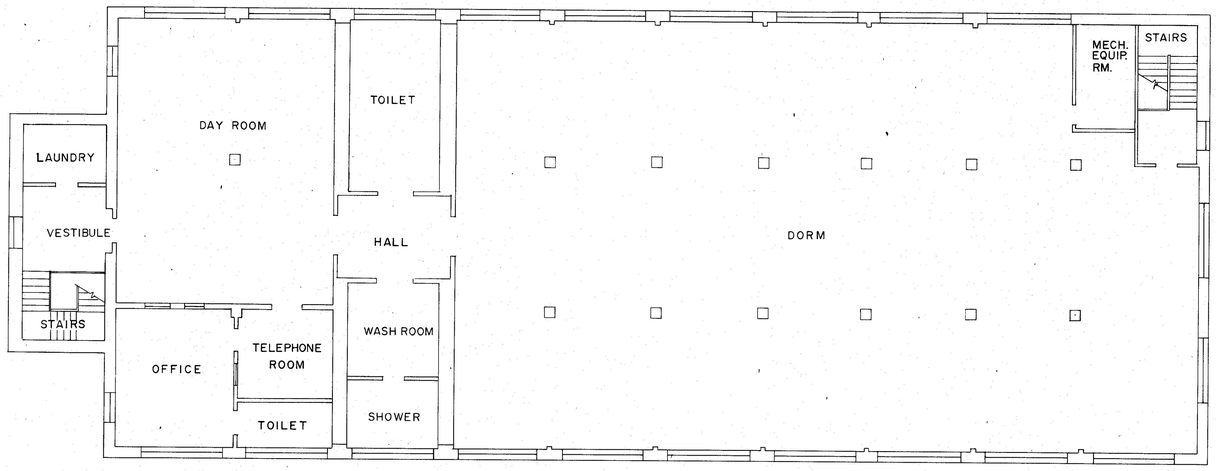

SECOND FLOOR PLAN — DORM NO. 7

SCALE: 1/8" = 1'-0"

ASBESTOS CONTAINING MATERIALS (ACM)
LORTON REFORMATORY
DORMITORY NO. 7
SECOND FLOOR

KEY NUMBER	LOCATION	MATERIAL	% ASBESTOS CONTENT	ESTIMATED QUANTITY L.F.	S.F.	OTHER	COMMENTS

NO ACM TO BE REMOVED ON THIS FLOOR

NOTE: Roof shingles contain asbestos; therefore, during any demolition or removal of shingles, workers shall use respiratory protection and all roofing shingles shall be disposed of as ACM.

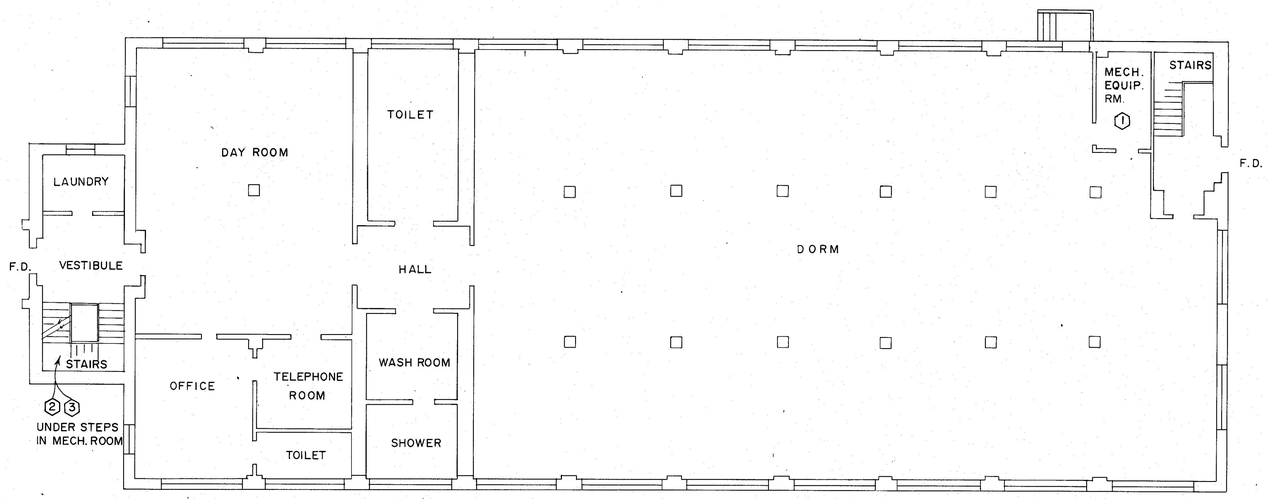

GROUND FLOOR PLAN — DORM NO. 6

SCALE: 1/8" = 1'-0"

ASBESTOS CONTAINING MATERIALS (ACM)
LORTON REFORMATORY
DORMITORY NO. 6
GROUND FLOOR

KEY NUMBER	LOCATION	MATERIAL	% ASBESTOS CONTENT	ESTIMATED QUANTITY L.F.	S.F.	OTHER	COMMENTS
1	Mechanical Room	AHU Vibration Isolator	15-20% Chrysotile 1-5% Amosite	--	12	--	
2	Basement Mechanical Room	Pipe Fitting Insulation	5-10% Chrysotile 10-15% Amosite	--	--	60 ea.	
3	Basement Mechanical Room	Pipe Insulation	5-10% Chrysotile 1-5% Amosite	--	--	--	No access to date.

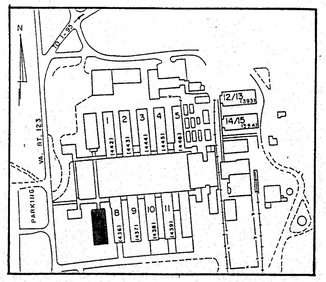

KEY PLAN

ASBESTOS ABATEMENT PROJECT DESIGNER

VONNIE M. MORAN — DATE — P.D. NO. 408

DESIGNED V. M. M.
DRAWN E. Z.
CHECKED J. L.

CERTIFICATION

CHIEF BUREAU OF BUILDING CONSTRUCTION SERVICES — REGISTRATION NO. — DATE

ARCHITECT — DATE

REVISION	DATE	DESCRIPTION	BY	APP

PROJECT DRAWINGS

GROUND FLOOR PLAN — DORM NO. 6 AND SECOND FLOOR PLAN — DORM NO. 7

ASBESTOS ABATEMENT
OCCOQUAN FACILITY, LORTON REFORMATORY, LORTON, VIRGINIA

PEER CONSULTANTS, P.C.
1824 Redwood Terrace, N.W., Washington D.C., 20012

GOVERNMENT OF THE DISTRICT OF COLUMBIA
DEPARTMENT OF PUBLIC WORKS

ASBESTOS REMOVAL

DRAWING NO. AR-3

BLDG. NO. 435
PROJECT NO. 6J1
DATE
SHEET 4 OF 8

1" = 10' | 1" = 20' | 1" = 30' | 1" = 40' | 1" = 50' | 1" = 100' | 1" = 200' | 1" = 400' | 3" = 1'-0" | 1 1/2" = 1'-0" | 1" = 1'-0" | 3/4" = 1'-0" | 1/2" = 1'-0" | 3/8" = 1'-0" | 1/4" = 1'-0" | 3/16" = 1'-0" | 1/8" = 1'-0" | 3/32" = 1'-0" | 1/16" = 1'-0"