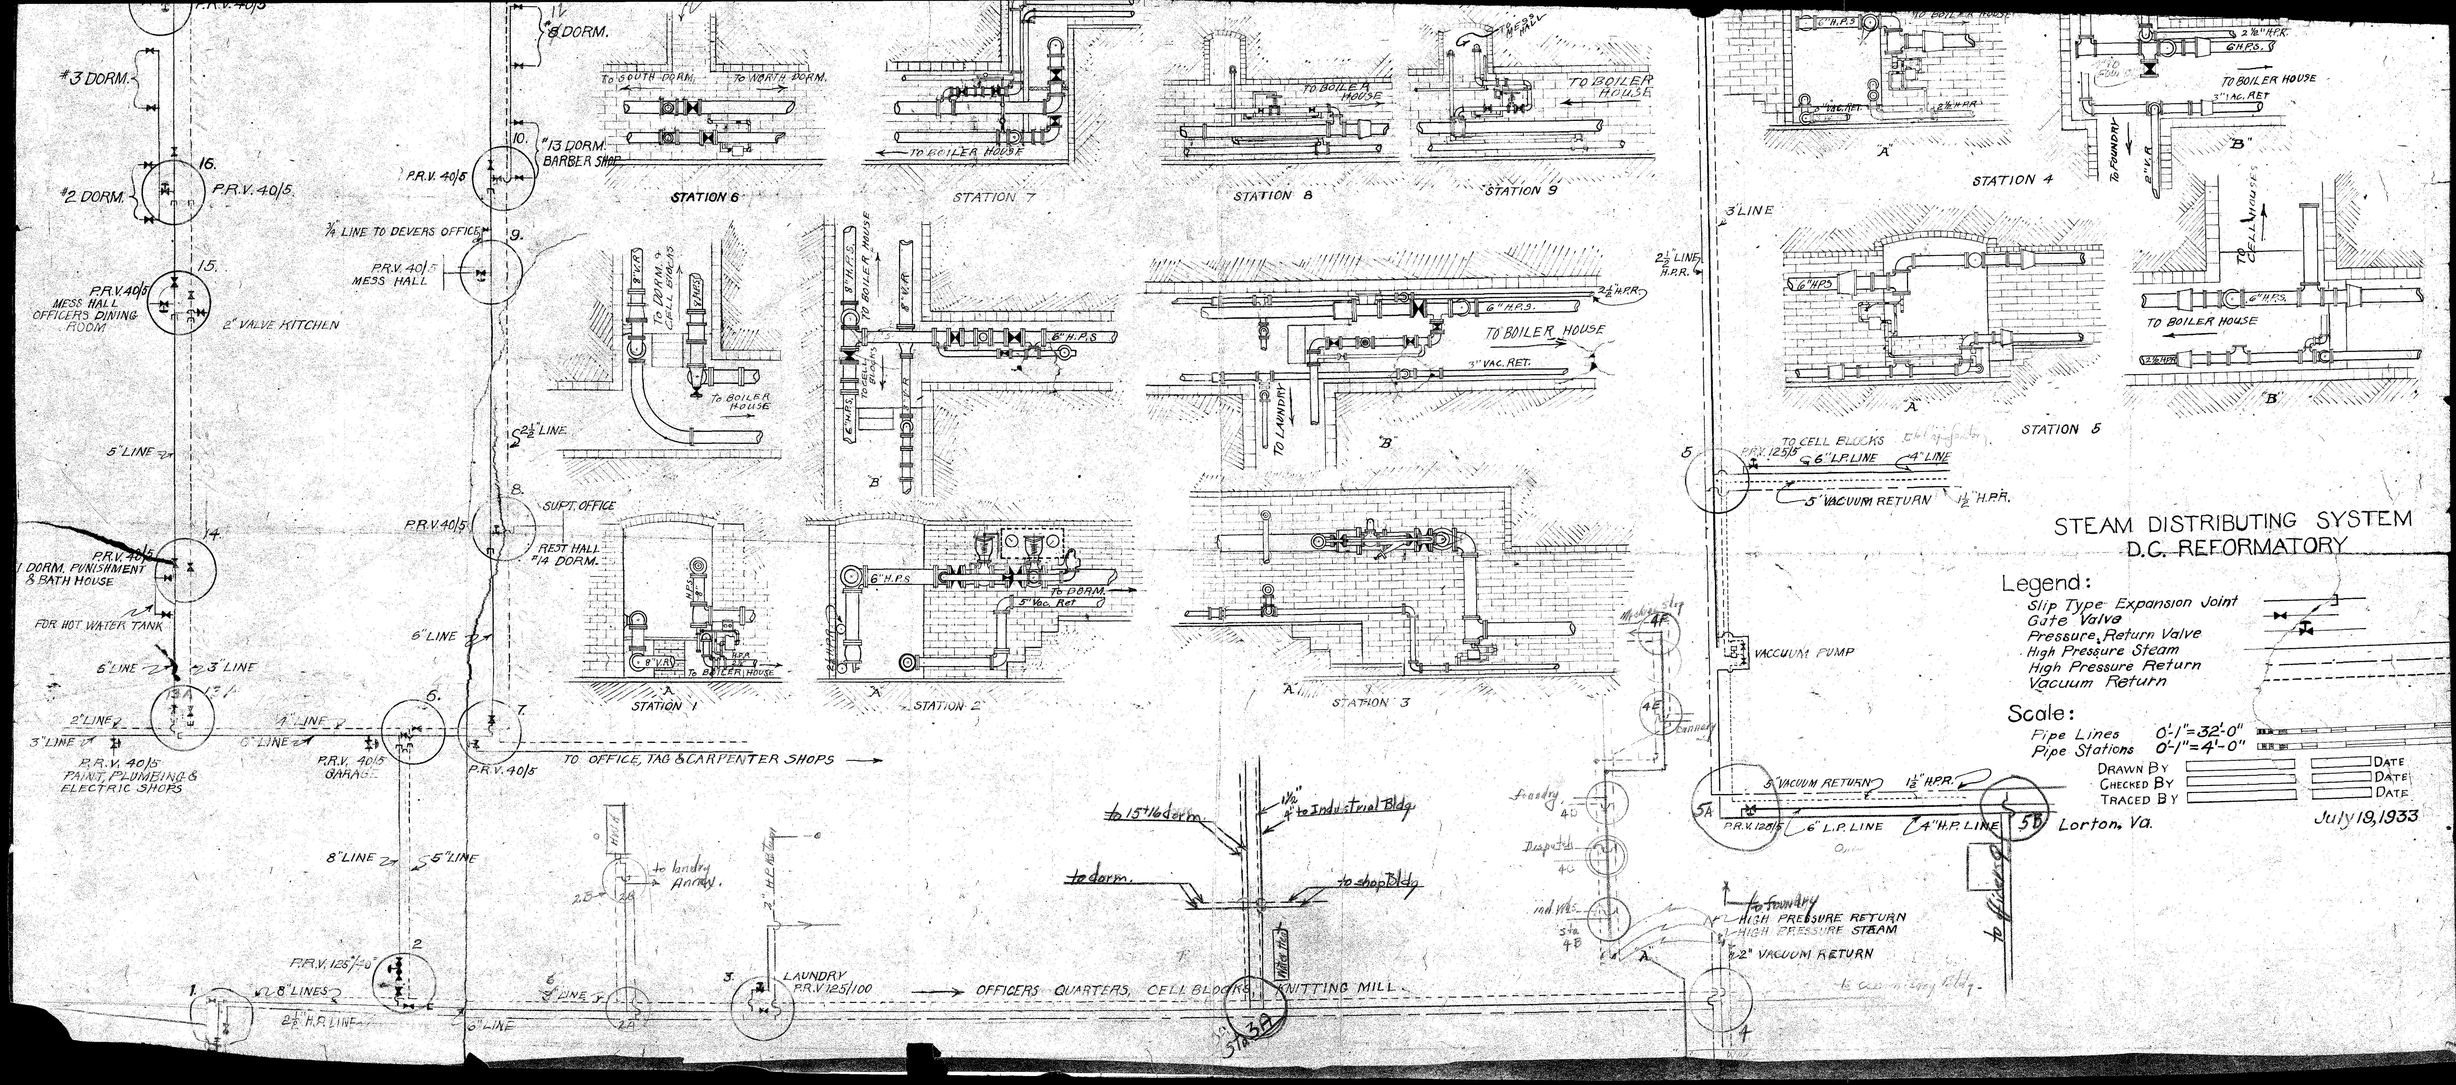
#3 DORM.
#2 DORM.
#8 DORM.
#13 DORM. BARBER SHOP
P.R.V. 40/5
16.
15.
14.
13.
12.
11.
10.
9.
8.
7.
6.
5.
4.
3.
2.
1.
P.R.V. 40/5 MESS HALL OFFICERS DINING ROOM
2" VALVE KITCHEN
P.R.V. 40/5 MESS HALL
3/4 LINE TO DEVERS OFFICE
P.R.V. 40/5 #1 DORM. PUNISHMENT & BATH HOUSE
FOR HOT WATER TANK
P.R.V. 40/5 PAINT, PLUMBING & ELECTRIC SHOPS
P.R.V. 40/5 GARAGE
P.R.V. 40/5 SUPT. OFFICE
P.R.V. 40/5 REST HALL #14 DORM.
P.R.V. 40/5
P.R.V. 125/40
P.R.V. 125/100 LAUNDRY
5" LINE
6" LINE
8" LINES
2" LINE
3" LINE
4" LINE
2½" H.P.R. LINE
TO OFFICE, TAG & CARPENTER SHOPS
TO OFFICERS QUARTERS, CELL BLOCKS, KNITTING MILL
to laundry
Annex
STATION 6
To SOUTH DORM.
To NORTH DORM.
STATION 7
TO BOILER HOUSE
STATION 8
STATION 9
STATION 1
STATION 2
STATION 3
STATION 4
STATION 5
TO BOILER HOUSE
TO LAUNDRY
TO DORM.
TO CELL BLOCKS
TO CELL HOUSES
6" H.P.S.
8" H.P.S.
2½" H.P.R.
3" VAC. RET.
5" Vac. Ret
8" VAC.
6" H.R.
4" H.R.
2½" H.R.
2" H.R.
2" H.P.S.
2½" H.P.S.
3" VAC. RET.
2" V.R.
TO FOUNDRY
TO BOILER HOUSE
3" AG. RET
2½" H.P.R.
6" H.P.S.
TO CELL BLOCKS
P.R.V. 125/5
6" L.P. LINE
4" LINE
5" VACUUM RETURN
1½" H.P.R.
VACUUM PUMP
5A
5B
P.R.V. 125/5
6" L.P. LINE
4" H.P. LINE
Lorton, Va.
to 15th & 16th dorm.
1½" to Industrial Bldg
to dorm.
to shop Bldg
Laundry
40
Dispatch
40
Ind. Wks.
3 to 4B
4F
4E
Tannery
to Foundry
HIGH PRESSURE RETURN
HIGH PRESSURE STEAM
2" VACUUM RETURN
to Tannery Bldg.
STEAM DISTRIBUTING SYSTEM
D.C. REFORMATORY
Legend:
Slip Type Expansion Joint
Gate Valve
Pressure Return Valve
High Pressure Steam
High Pressure Return
Vacuum Return
Scale:
Pipe Lines 0'-1"=32'-0"
Pipe Stations 0'-1"=4'-0"
DRAWN BY
CHECKED BY
TRACED BY
DATE
DATE
DATE
July 19, 1933