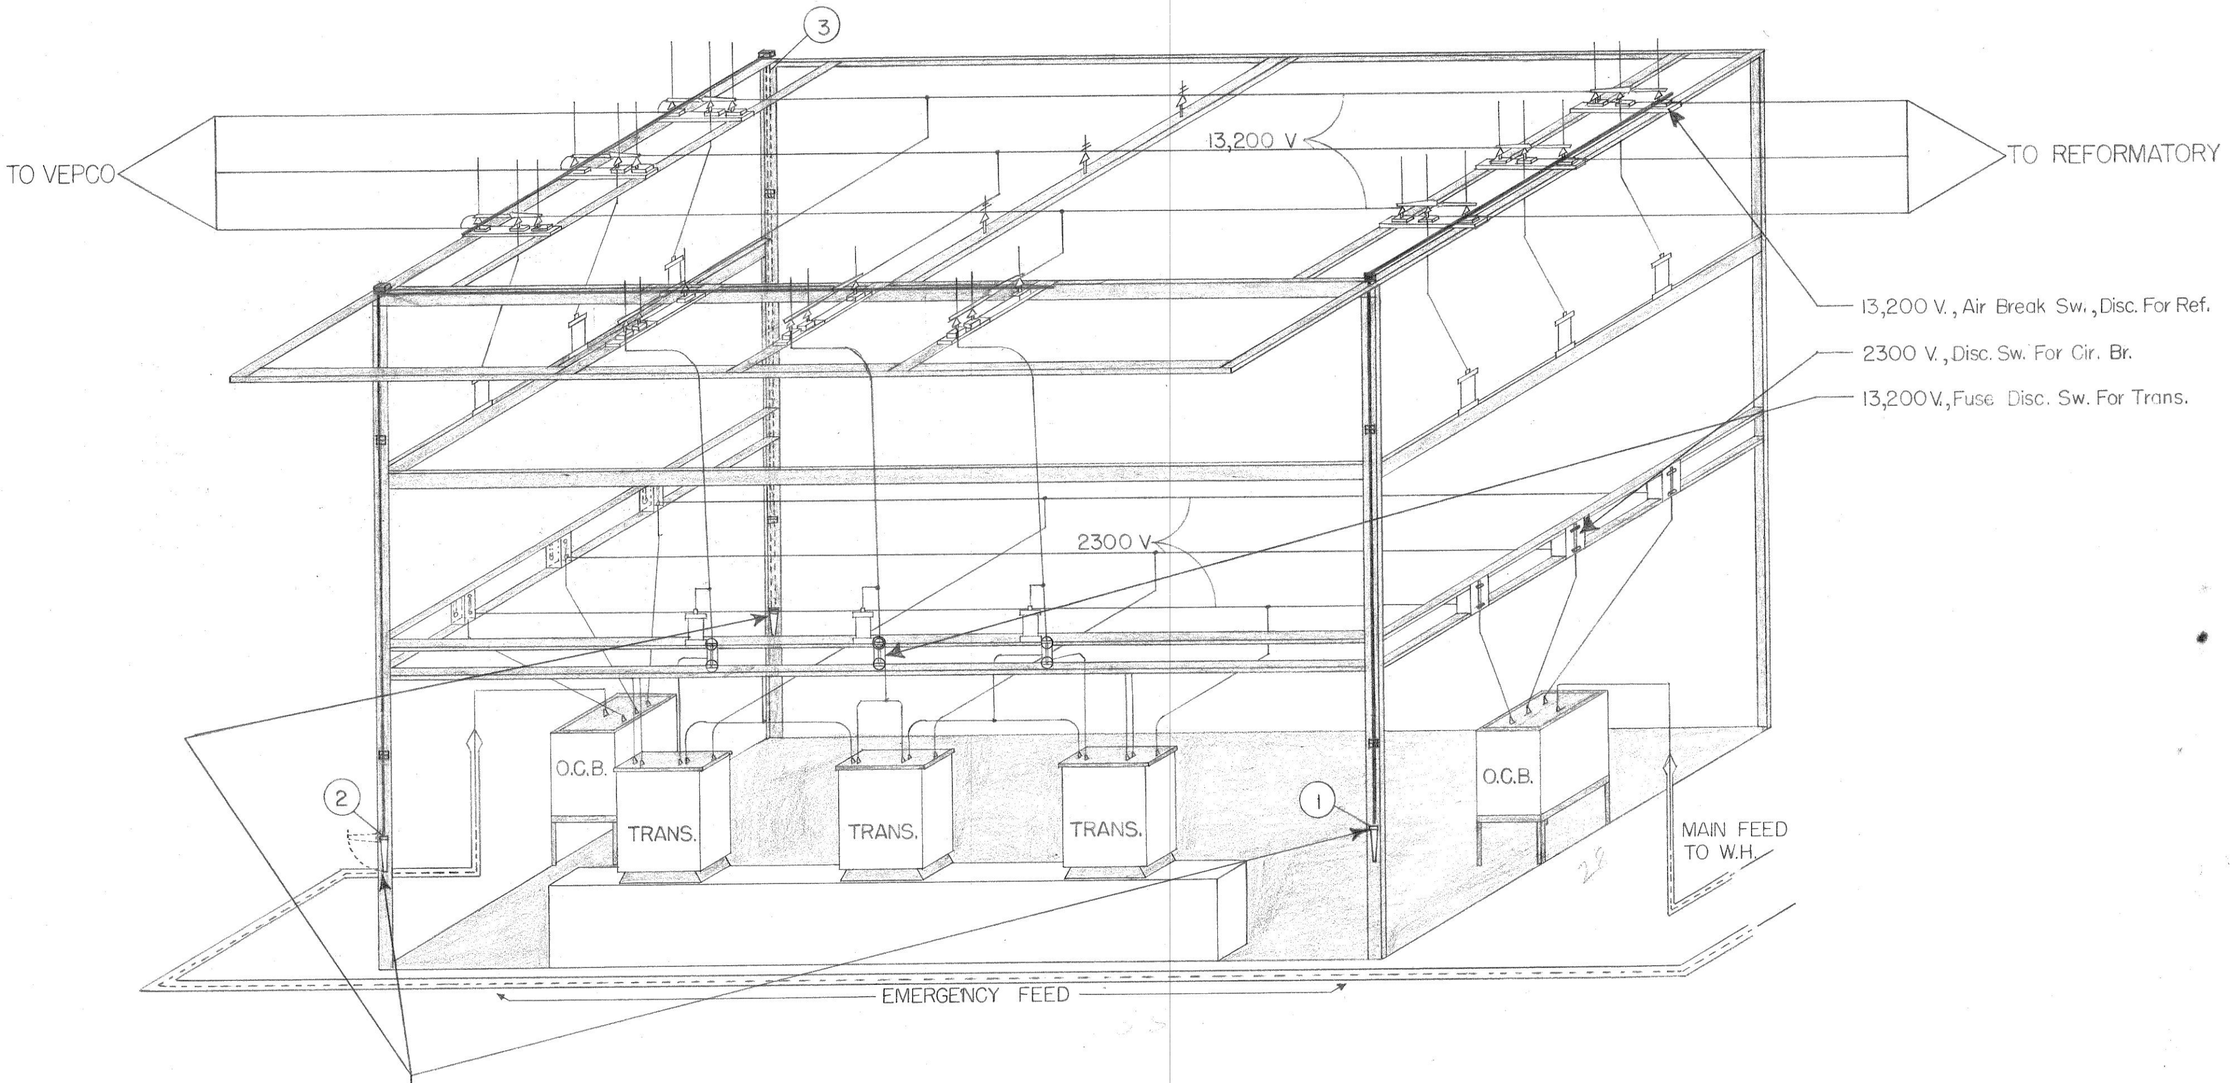

(1) Disconnects Reformatory

(2) Disconnects Trans.

(3) Disconnects Both Institutions

WORKHOUSE SUBSTATION

ISOMETRICAL SCHETCH

DEPARTMENT OF CORRECTIONS, D.C.
OFFICE OF CHIEF ENGINEER
LORTON, VA.

Drawn-- 10/9/59 By-- Jim B. Edmonds

Appr'd. _____ By _____

Remarks:

D'W'G. NO. 1 OF 4