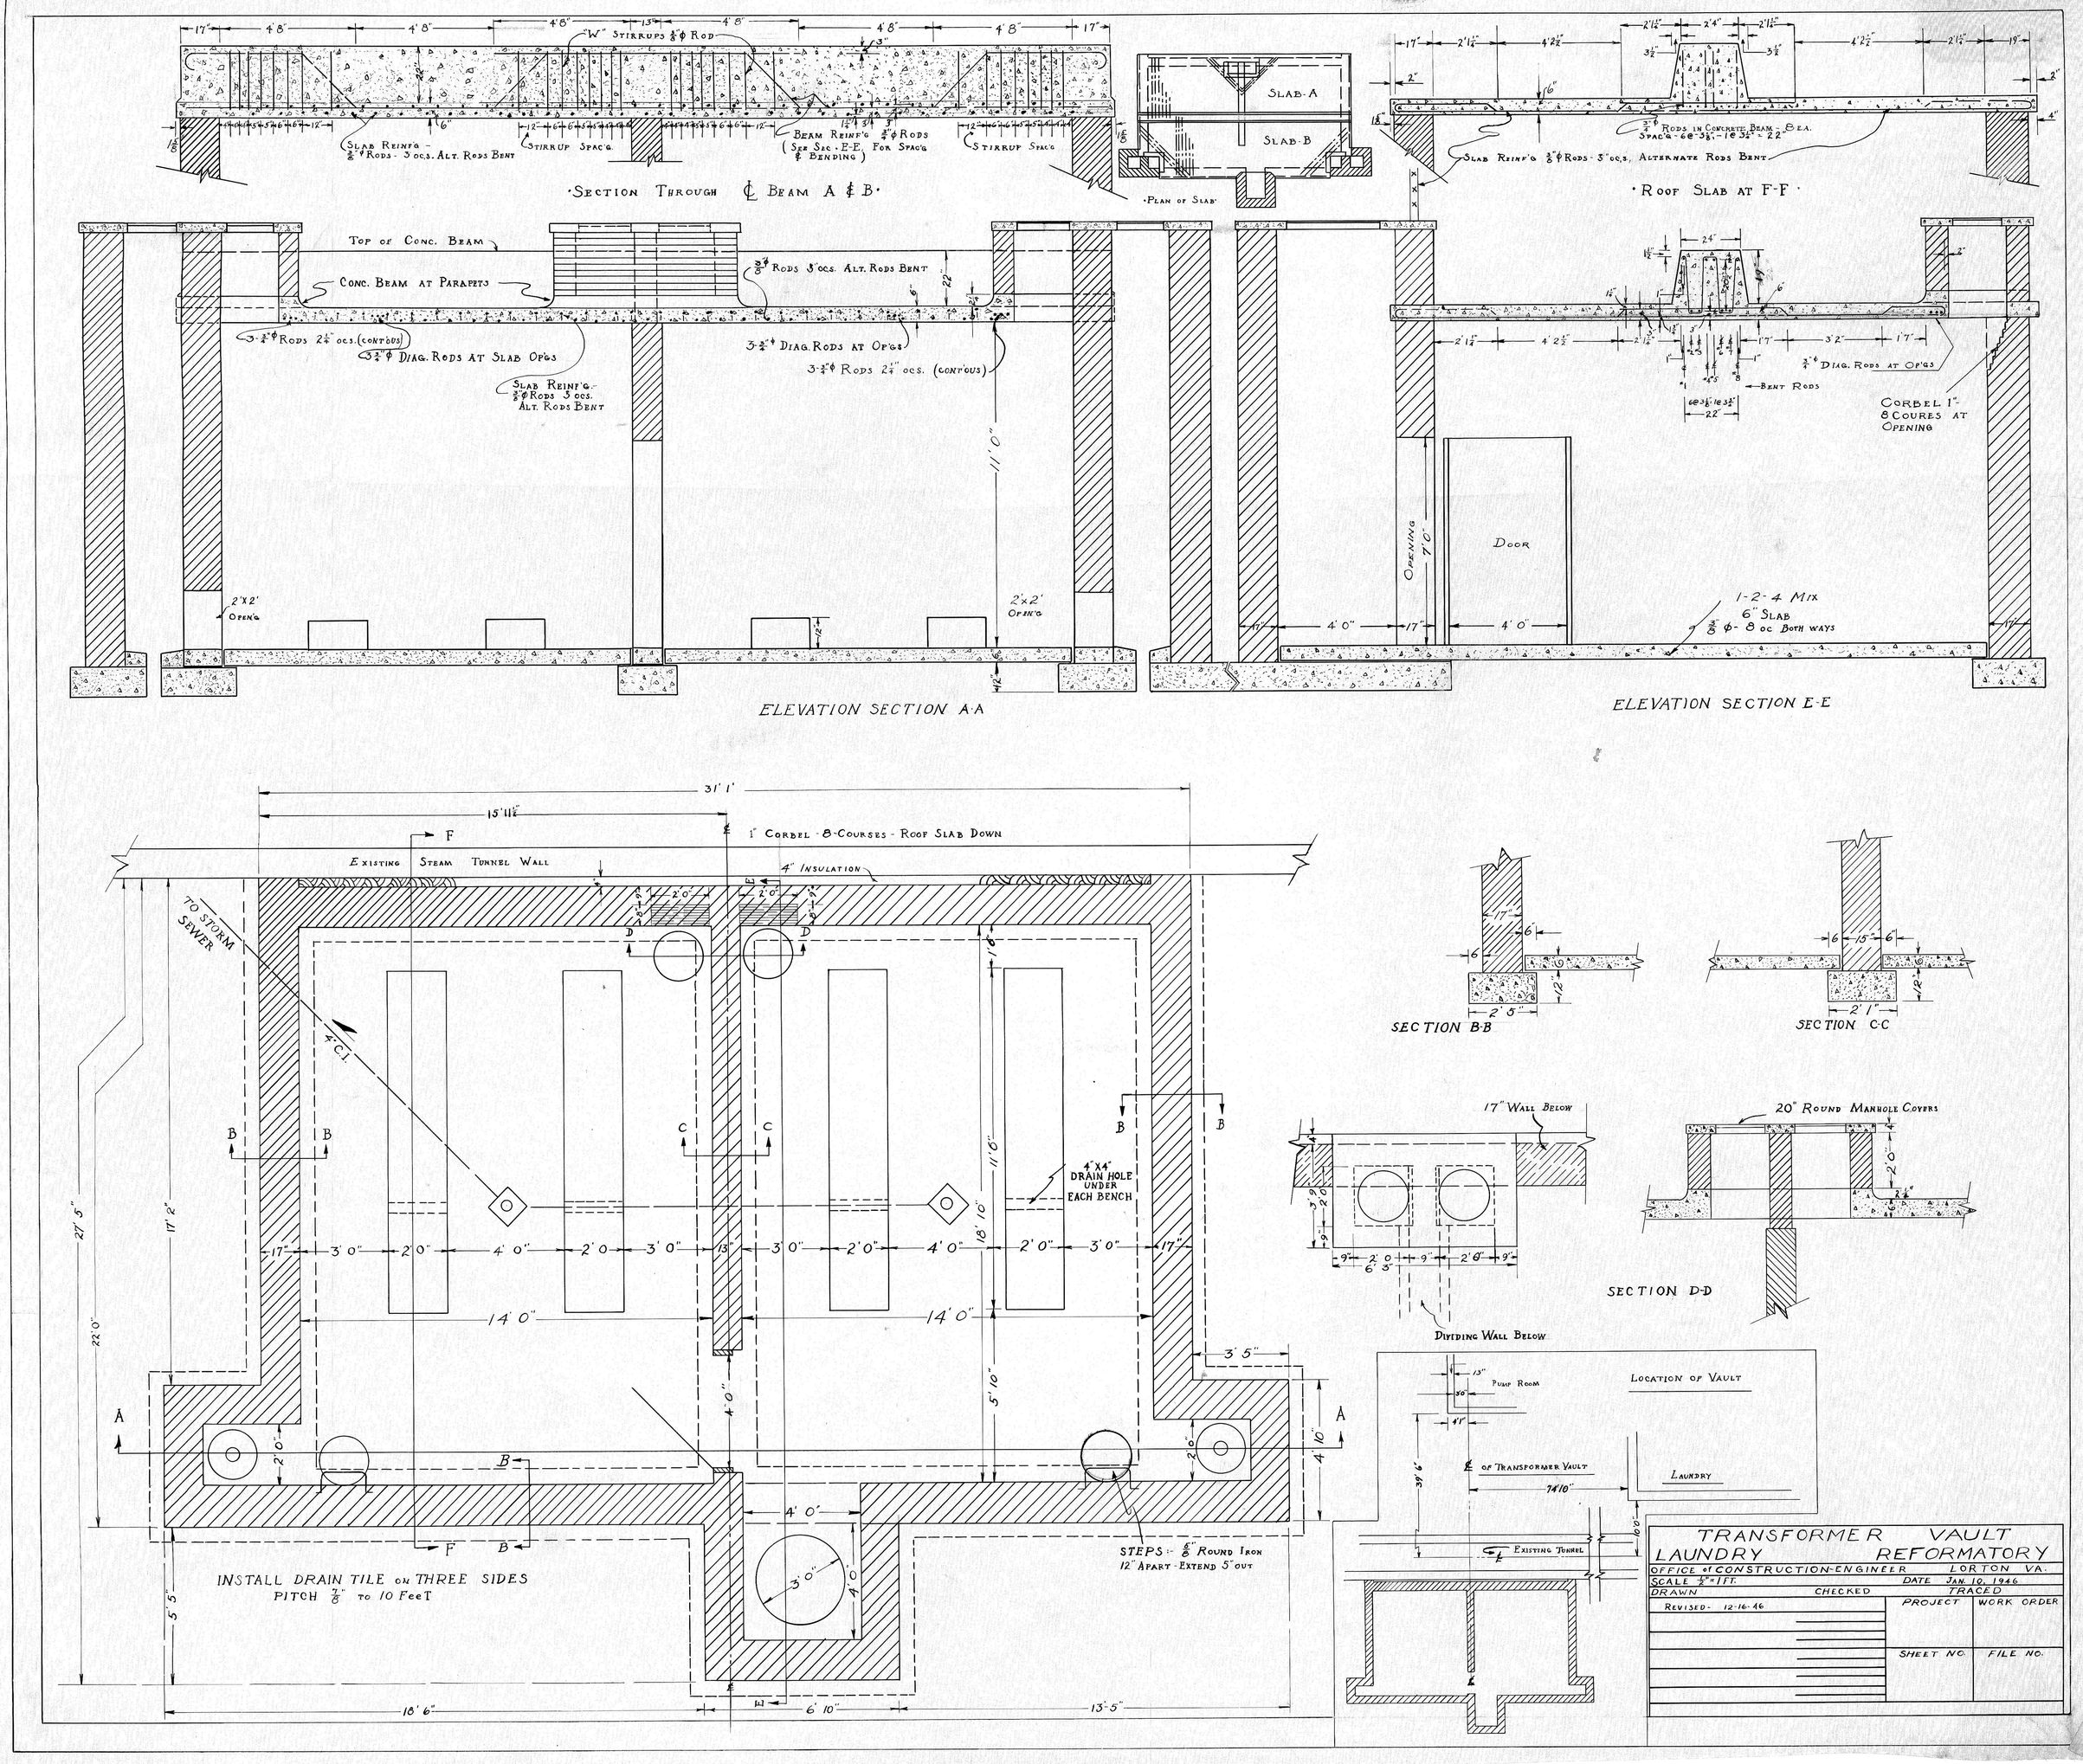
SECTION THROUGH ℄ BEAM A & B
"W" STIRRUPS 3/8"φ ROD
SLAB REINF'G - 3/8"φ RODS - 3" OC'S. ALT. RODS BENT
STIRRUP SPAC'G.
BEAM REINF'G 3/4"φ RODS (SEE SEC. E-E. FOR SPAC'G & BENDING)
PLAN OF SLAB
SLAB-A
SLAB-B
ROOF SLAB AT F-F
SLAB REINF'G 3/8"φ RODS - 3" OC'S, ALTERNATE RODS BENT
3/4"φ RODS IN CONCRETE BEAM - 8 EA.
TOP OF CONC. BEAM
CONC. BEAM AT PARAPETS
3/4"φ RODS 3" OC'S. ALT. RODS BENT
3-3/4"φ RODS 2 1/4" OC'S. (CONT'OUS)
3/4"φ DIAG. RODS AT SLAB OP'GS
SLAB REINF'G - 3/8"φ RODS 3" OC'S. ALT. RODS BENT
3-3/4"φ DIAG. RODS AT OP'GS
3-3/4"φ RODS 2 1/4" OC'S. (CONT'OUS)
11'0"
2'x2' OPEN'G
ELEVATION SECTION A-A
3/4"φ DIAG. RODS AT OP'GS
BENT RODS
CORBEL 1" 8 COURES AT OPENING
OPENING 7'0"
DOOR
1-2-4 MIX 6" SLAB 3/8"φ - 8" OC BOTH WAYS
ELEVATION SECTION E-E
31'1"
15'11 1/2"
1" CORBEL - 8-COURSES - ROOF SLAB DOWN
EXISTING STEAM TUNNEL WALL
4" INSULATION
TO STORM SEWER
4" C.I.
4"X4" DRAIN HOLE UNDER EACH BENCH
14'0"
STEPS - 5/8" ROUND IRON 12" APART - EXTEND 5" OUT
INSTALL DRAIN TILE ON THREE SIDES PITCH 7/8" TO 10 FEET
SECTION B-B
SECTION C-C
17" WALL BELOW
DIVIDING WALL BELOW
20" ROUND MANHOLE COVERS
SECTION D-D
PUMP ROOM
LOCATION OF VAULT
℄ OF TRANSFORMER VAULT
LAUNDRY
EXISTING TUNNEL
TRANSFORMER VAULT
LAUNDRY REFORMATORY
OFFICE of CONSTRUCTION-ENGINEER LORTON VA.
SCALE 1/4" = 1 FT. DATE JAN. 10, 1946
DRAWN CHECKED TRACED
REVISED - 12-16-46
PROJECT
WORK ORDER
SHEET NO.
FILE NO.