NOTES

All elevations on Sewers to be (INV.).
Sewer connections to Buildings to be Ex. H. C.I.
Sewer connections between Manholes to be T. C. glazed. With 1:2 Mortar mix. = Joints.
All manholes to be brick, parged outside up to grade, inside parged 4'0 above the highest sewer inlet. to be 4'0" sq. with a 24" C.I. Top set to finished grade.
Each joint of pipe to be thoroughly wiped before the next is placed.

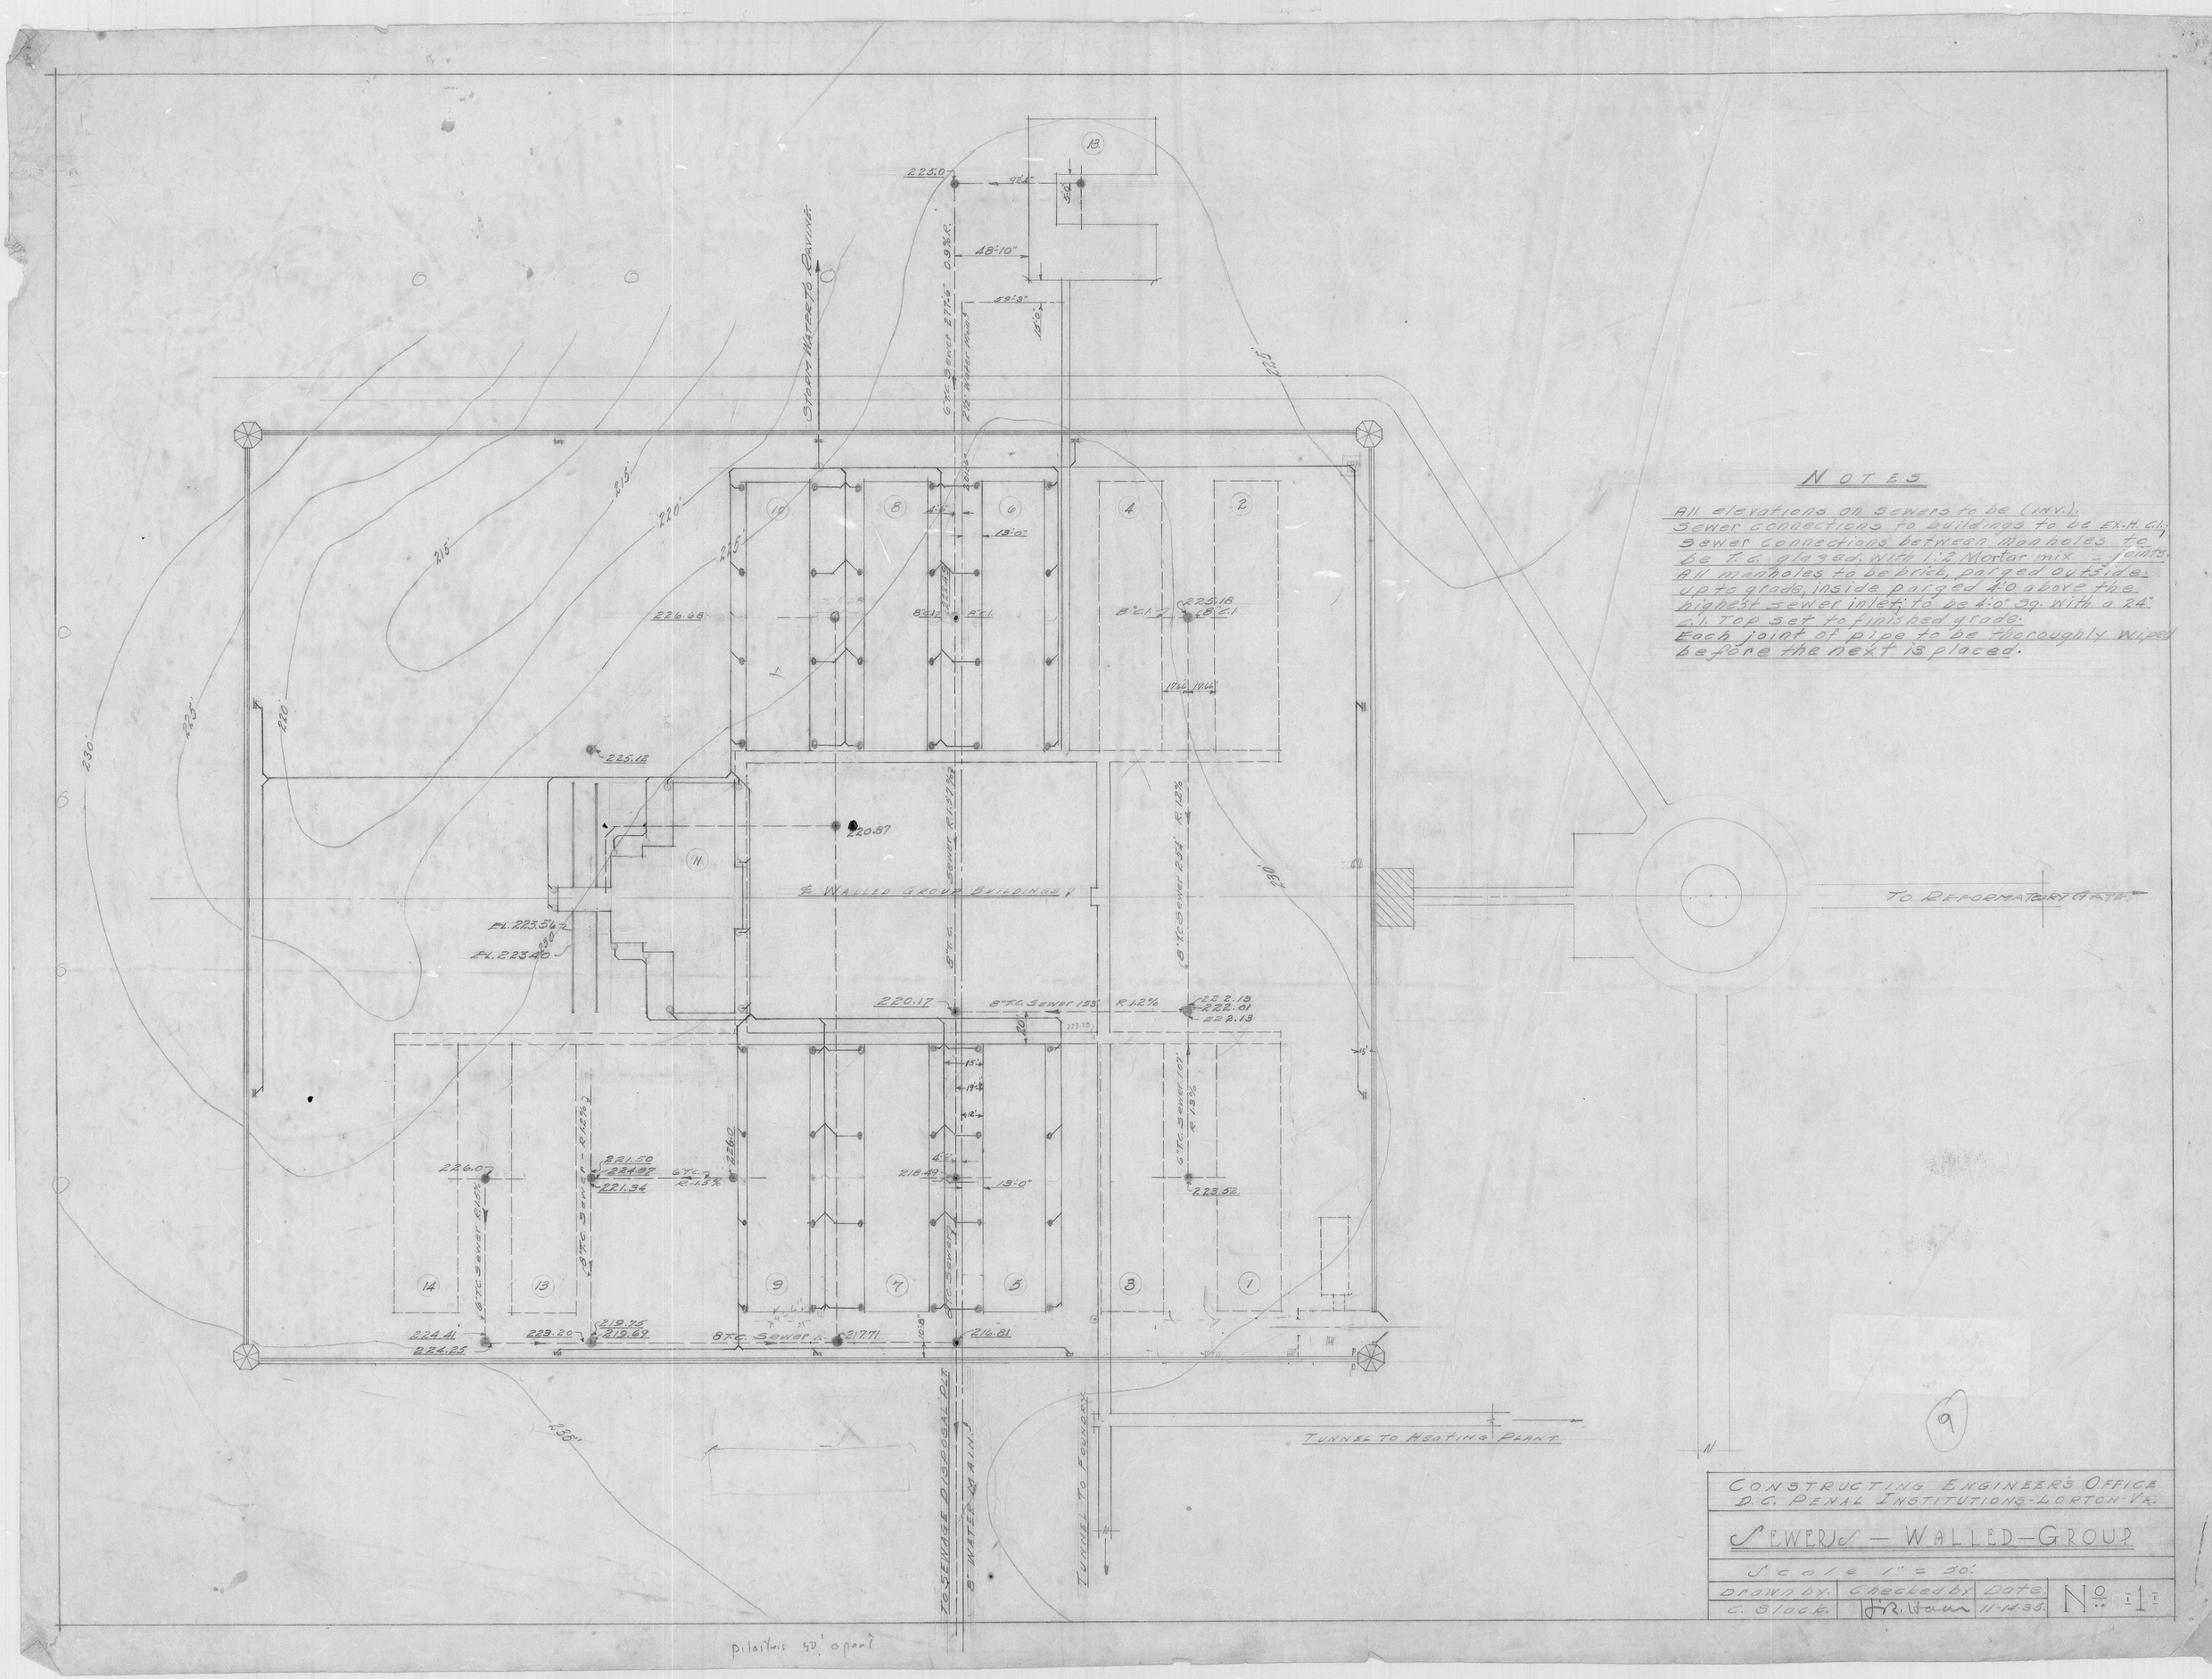

CONSTRUCTING ENGINEER'S OFFICE
D. C. PENAL INSTITUTIONS - LORTON - VA.

SEWERS — WALLED — GROUP

Scale 1" = 30'

Drawn by:	Checked by:	Date:	No. 1
C. Slack.	[illegible]	11-14-33.	

9