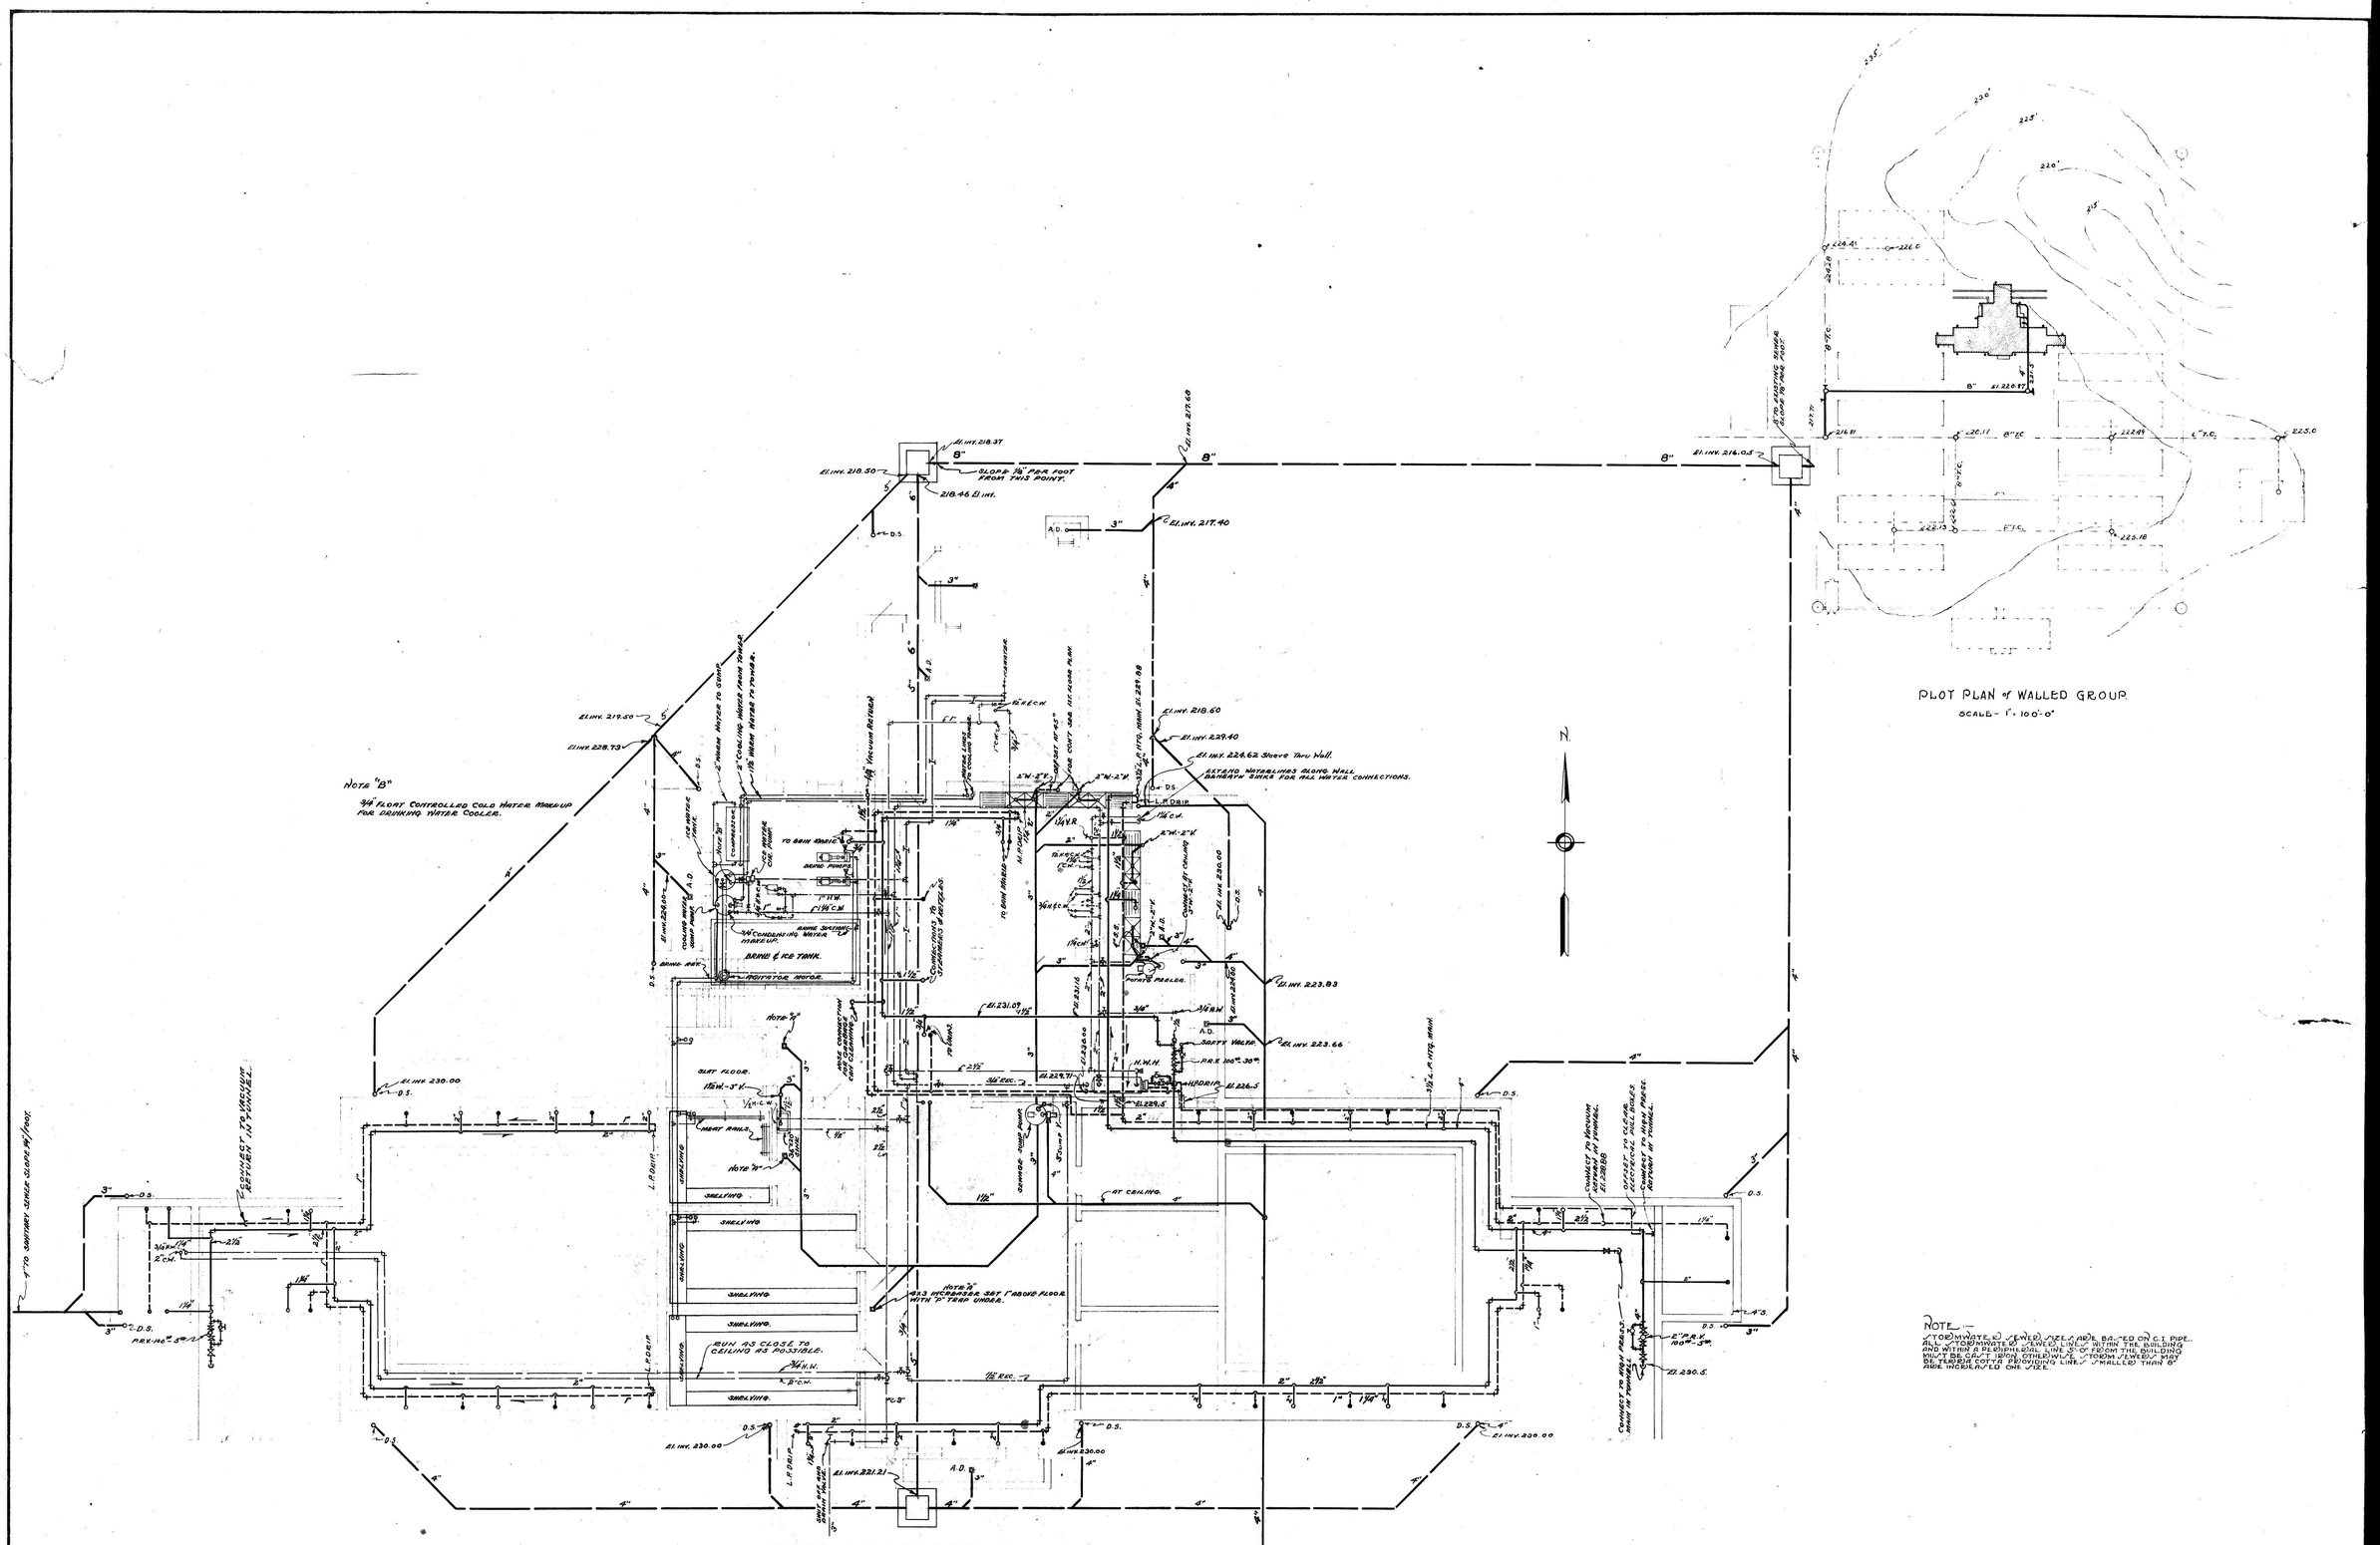


BASEMENT FLOOR PLAN

NOTE:—
STORMWATER SEWER SIZES ARE BASED ON C.I. PIPE. ALL STORMWATER SEWER LINES WITHIN THE BUILDING AND WITHIN A PERIPHERAL LINE 5'-0" FROM THE BUILDING MUST BE CAST IRON, OTHERWISE STORM SEWERS MAY BE TERRA COTTA PROVIDING LINES SMALLER THAN 8" ARE INCREASED ONE SIZE.

| | | | | |
|---|---|---|---|---|
| APPROVED BY THE COMMISSIONERS OF THE DISTRICT OF COLUMBIA SITTING AS A BOARD<br>[illegible] SECRETARY. | REVISIONS<br>Revised 10/25/36<br>Changed Vestibule Toilets And Storm water Sewers.<br>Revised 9/13/38 | WORK RECORD<br>DRAWN BY H.A.S. A.H.G.<br>TRACED BY R.F. Rock.<br>CHECKED BY C.A.S.<br>DATE 7-17-36<br>SHEET | BUILDING MESS HALL WALLED GROUP<br>LOCATION D. C. PENAL INSTITUTIONS LORTON, VA.<br>OFFICE OF MUNICIPAL ARCHITECT—WASHINGTON, D. C.<br>CHIEF OF ARCHITECTURAL DIVISION [signature] DATE 7-17-36<br>CHIEF OF STRUCTURAL DIVISION [signature] DATE 7-17-36<br>CHIEF OF MECHANICAL DIVISION [signature] DATE 7-17-36<br>MUNICIPAL ARCHITECT [signature] DATE 7-17-36 | FILE NO.<br>DRWG. NO.<br>M<br>1 |