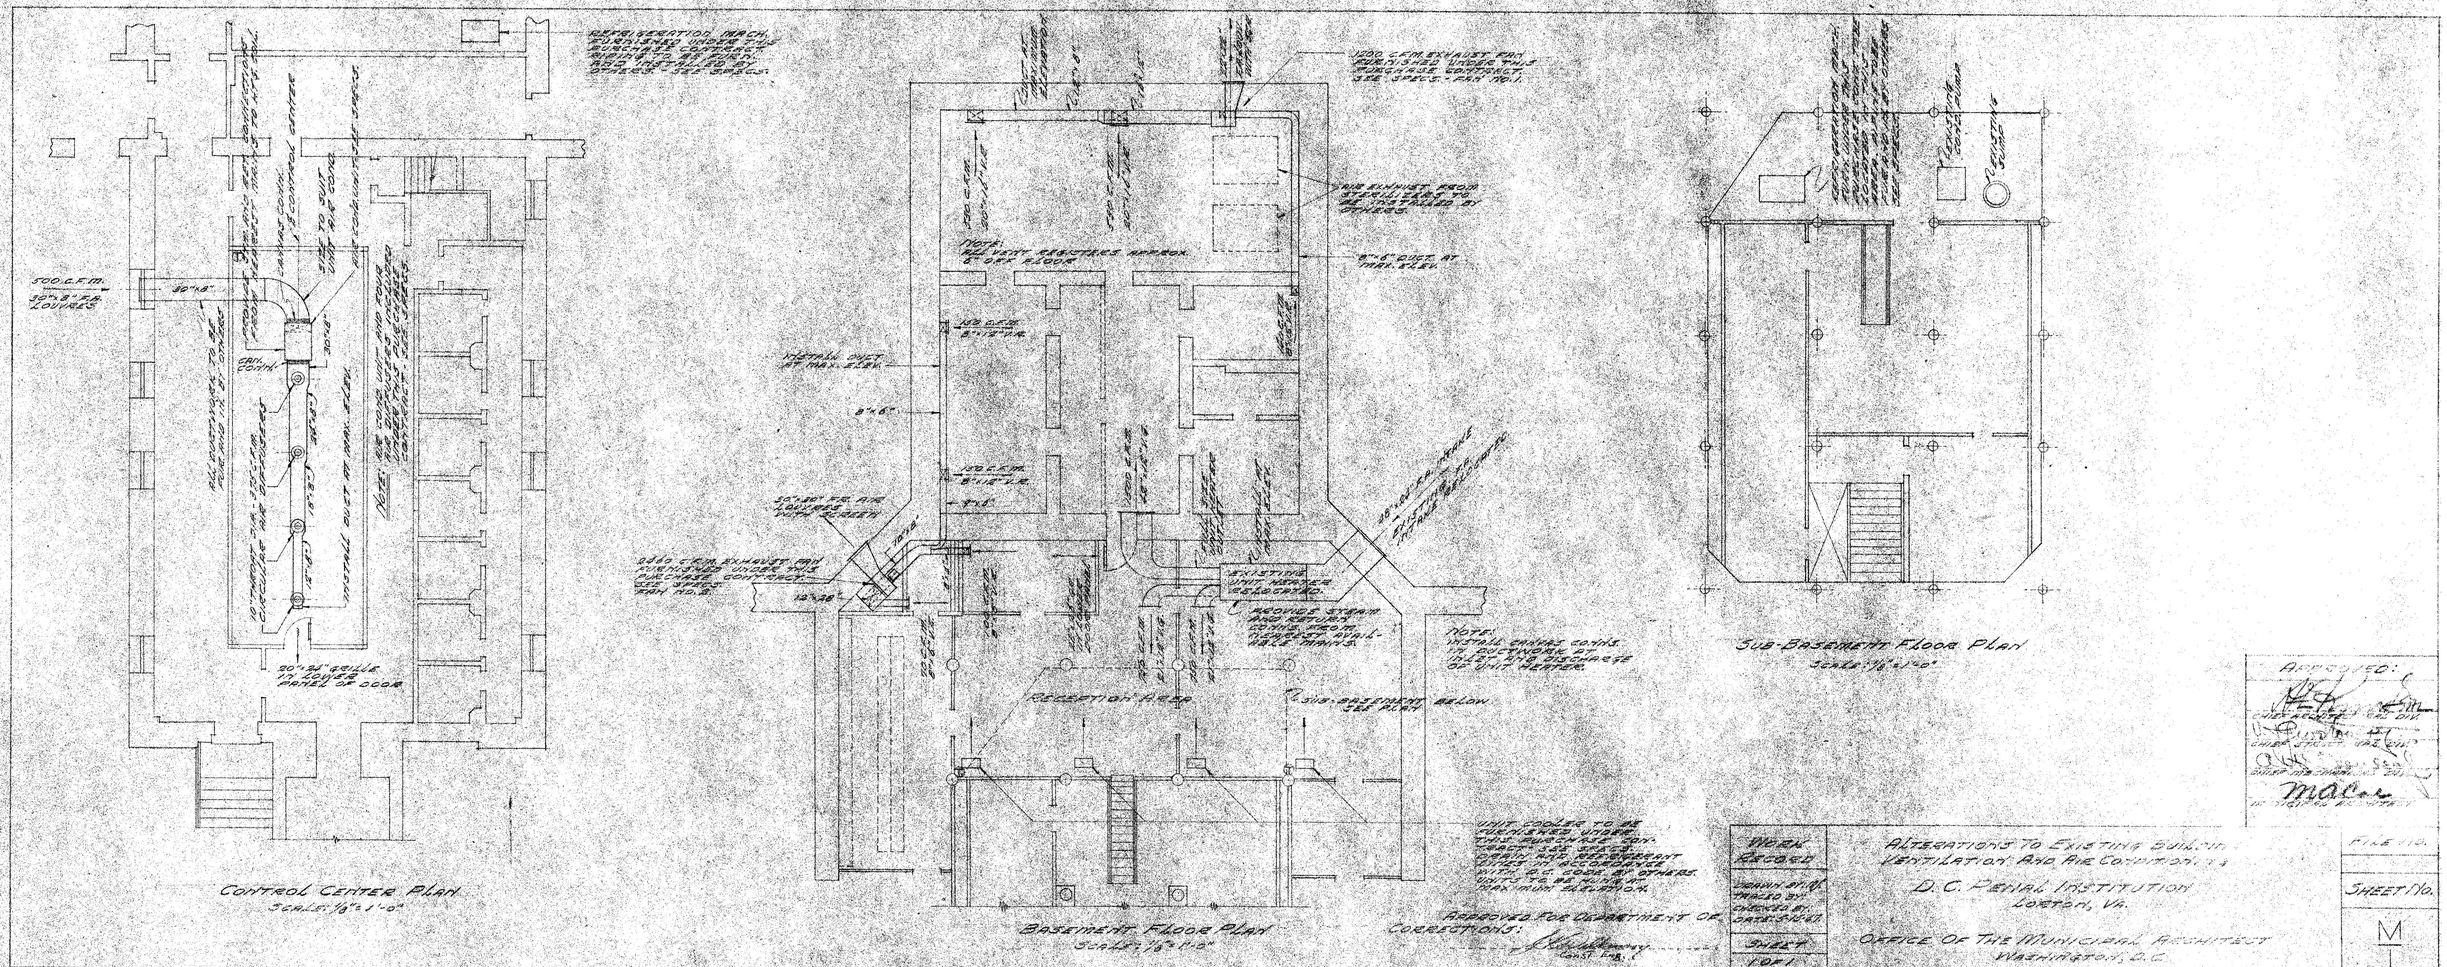
CONTROL CENTER PLAN
SCALE: 1/8" = 1'-0"
BASEMENT FLOOR PLAN
SCALE: 1/8" = 1'-0"
SUB-BASEMENT FLOOR PLAN
SCALE: 1/8" = 1'-0"
RECEPTION AREA
SUB-BASEMENT BELOW SEE PLAN
NOTE: INSTALL CANVAS CONNS. IN DUCTWORK AT INLET AND DISCHARGE OF UNIT HEATER.
NOTE: ALL VENT REGISTERS APPROX. 6" OFF FLOOR
INSTALL DUCT AT MAX. ELEV.
AIR EXHAUST FROM STERILIZERS TO BE INSTALLED BY OTHERS.
1200 C.F.M. EXHAUST FAN FURNISHED UNDER THIS PURCHASE CONTRACT. SEE SPECS. - FAN NO. 1.
REFRIGERATION MACH. FURNISHED UNDER THIS PURCHASE CONTRACT. RIGHT TO BE FURN. AND INSTALLED BY OTHERS. - SEE SPECS.
500 C.F.M. 30"x8" F.A. LOUVRES
20"x24" GRILLE IN LOWER PANEL OF DOOR
UNIT COOLER TO BE FURNISHED UNDER THIS PURCHASE CONTRACT. SEE SPECS. DRAIN AND REFRIGERANT LINES IN ACCORDANCE WITH D.C. CODE BY OTHERS. UNITS TO BE HUNG AT MAXIMUM ELEVATION.
APPROVED FOR DEPARTMENT OF CORRECTIONS:
CONST. ENG.
WORK RECORD
DRAWN BY: TRACED BY: CHECKED BY: DATE: 5-10-67
SHEET 1 OF 1
ALTERATIONS TO EXISTING BUILDING VENTILATION AND AIR CONDITIONING
D.C. PENAL INSTITUTION
LORTON, VA.
OFFICE OF THE MUNICIPAL ARCHITECT
WASHINGTON, D.C.
APPROVED:
CHIEF ARCHITECTURAL DIV.
CHIEF STRUCTURAL DIV.
CHIEF MECHANICAL DIV.
MACoe
MUNICIPAL ARCHITECT
FILE NO.
SHEET NO.
M
1