


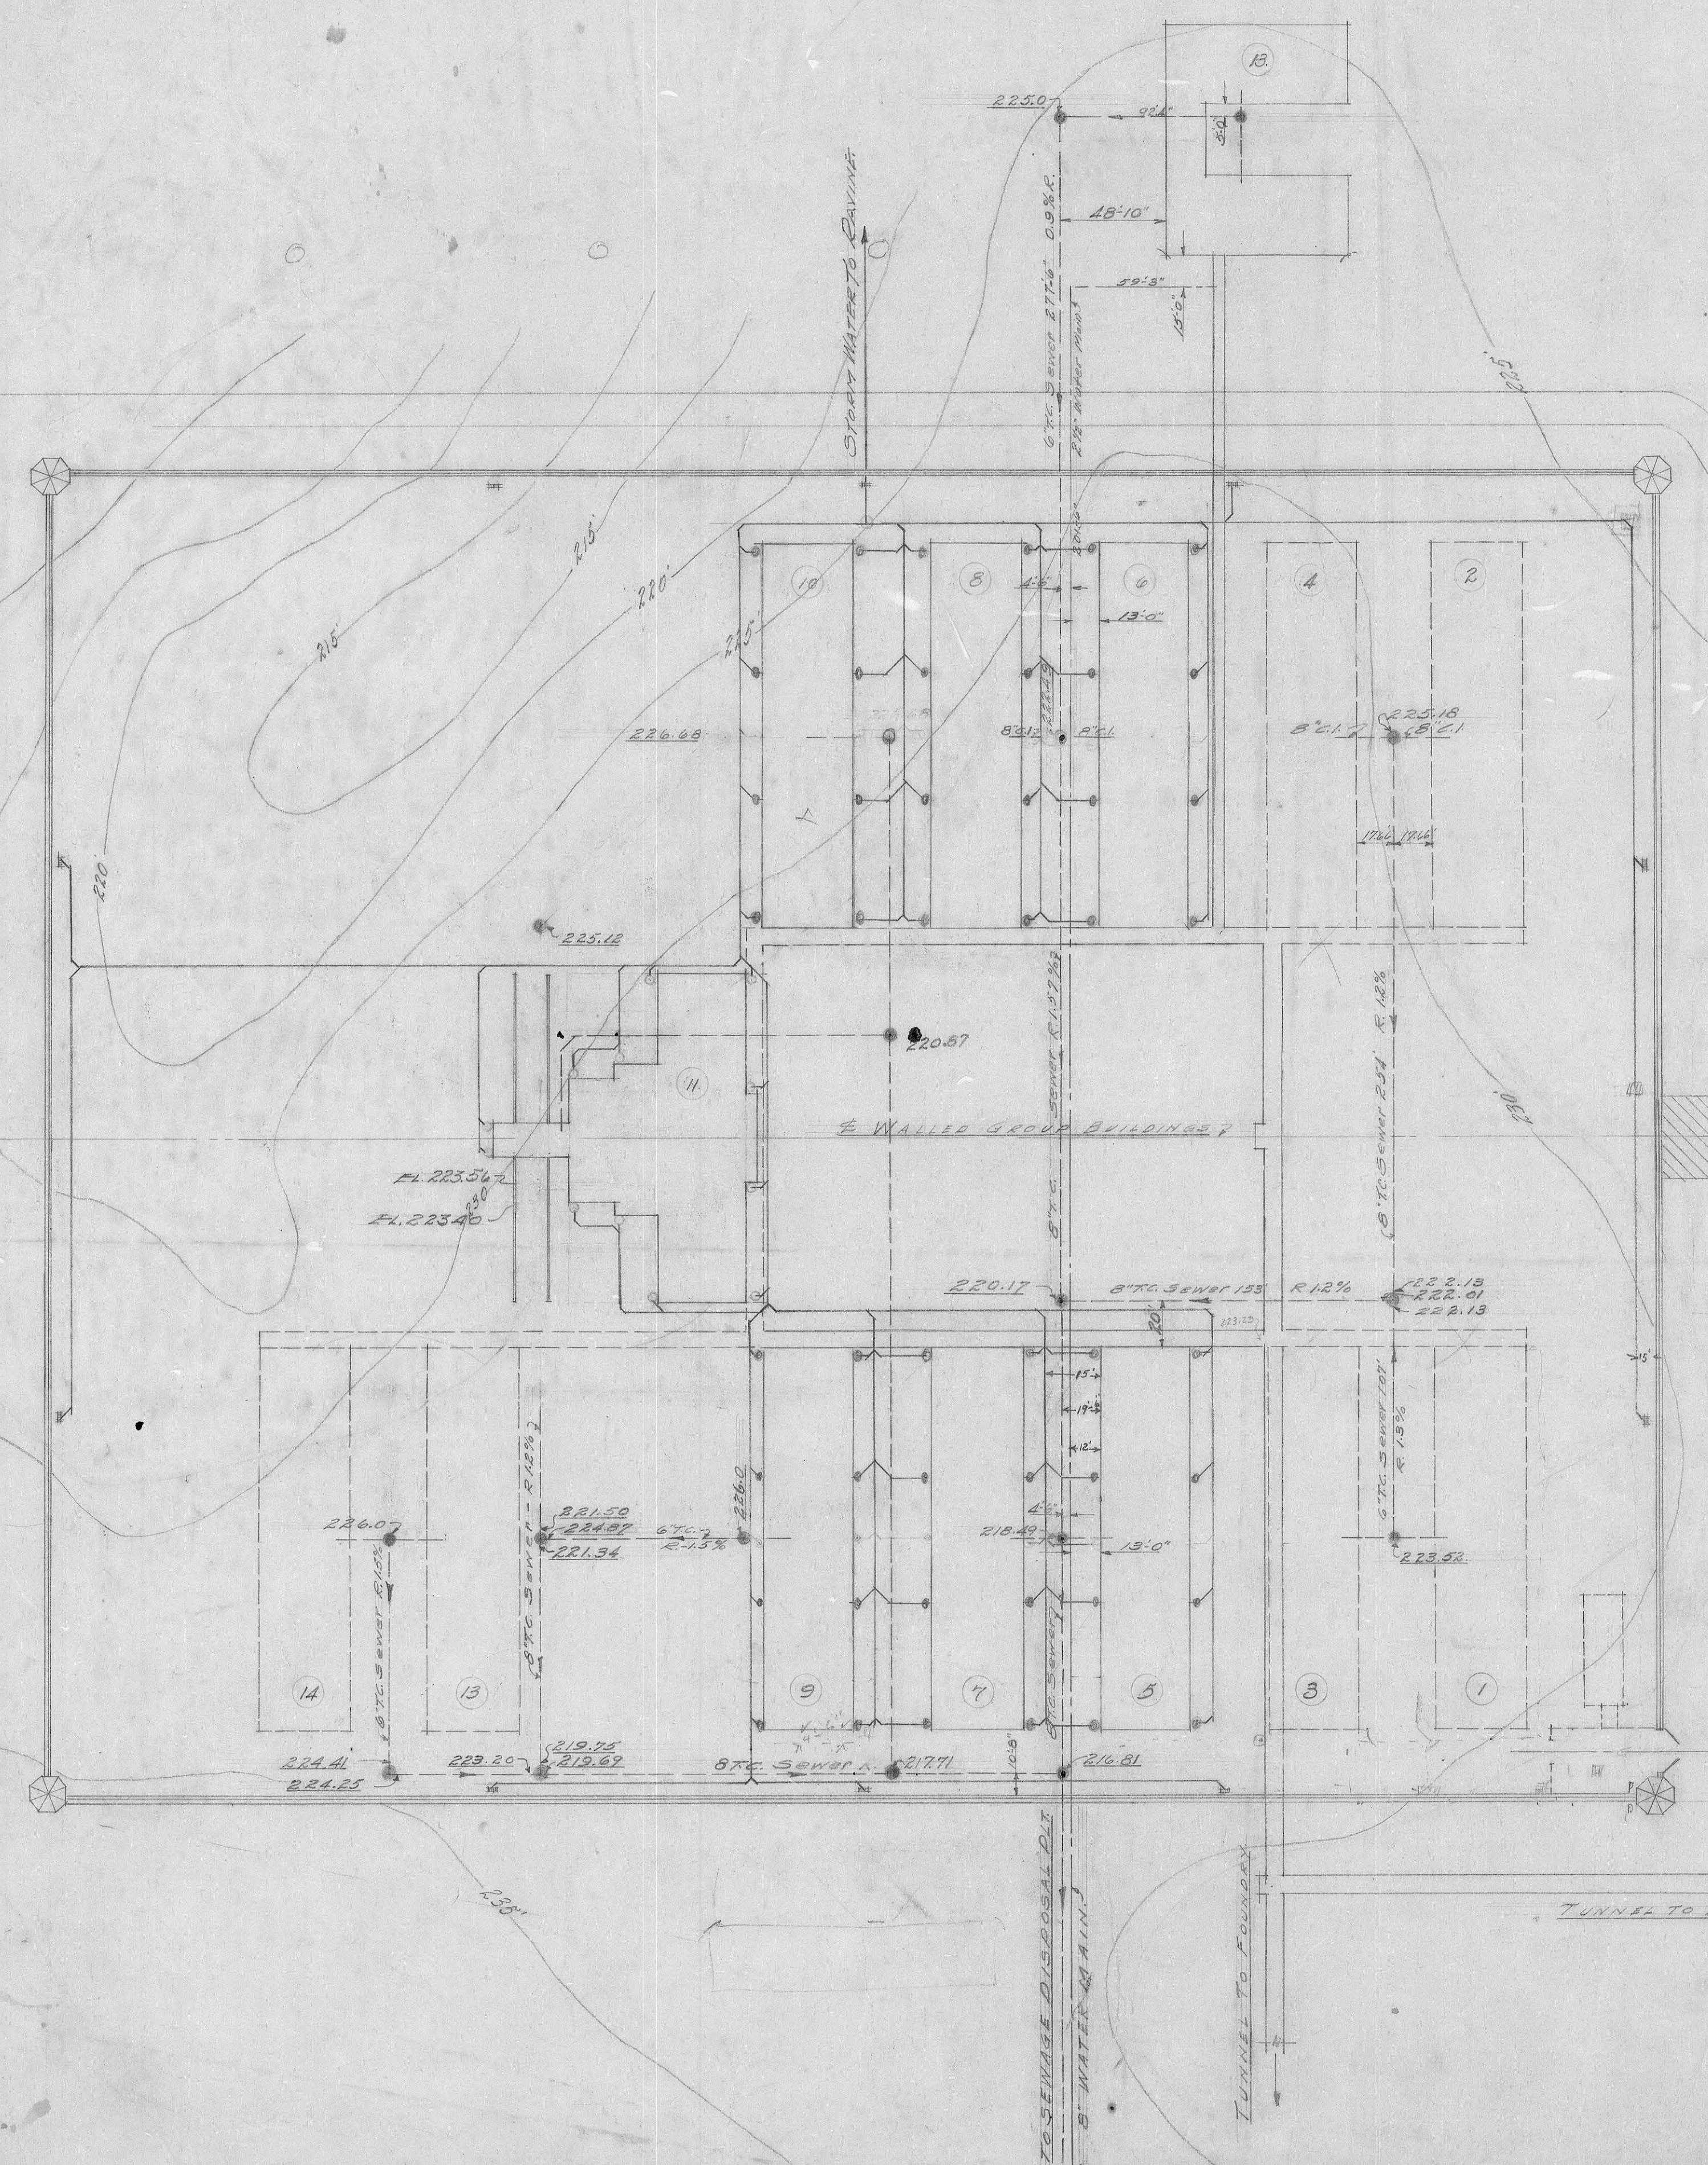

NOTES

All elevations on sewers to be (INV.).
 Sewer connections to buildings to be EX-H.A.,
 sewer connections between manholes to
 be T.C. glazed, with 1:2 Mortar mix - joints.
 All manholes to be brick, paved outside
 up to grade, inside paved 4'0" above the
 highest sewer inlet, to be 4'0" sq. with a 24"
 dia. top set to finished grade.
 Each joint of pipe to be thoroughly wiped
 before the next is placed.

CONSTRUCTING ENGINEERS OFFICE D.C. PENAL INSTITUTIONS - LORTON - VA.			
SEWERAGE - WALLED-GROUP			
Scale 1" = 50'			
Drawn by	Checked by	Date	No.
C. Block	J.R. Ham	11-14-33	111

p.l.s. 1/2" 50' 0" 1/2"